

FLOWING EXPERTISE

PRESSURE REDUCING VALVES  
FOR DOMESTIC WATER SYSTEMS

 **CALEFFI**  
Hydronic Solutions





## FLOWING EXPERTISE

With our heating and plumbing solutions, we have been redesigning the comfort of the spaces we live and work in for over 60 years. This is thanks to the flow of expertise, technology, experience and innovations that we have acquired over the years by constantly exchanging ideas with our customers and suppliers. A flow that pushes boundaries, allowing us to constantly set the benchmark. A flow that allows us to always look one step ahead into the future.



### FLOW OF LIFE

A unique way of flowing. It is **continuous change**, a high degree of reliability in our work, and the ongoing pursuit of total quality, which is the result of small daily actions.



### FUTURE

Innovation aimed at creating **new forms of comfort** for spaces, which motivates us to continue to grow and improve.



### SUSTAINABILITY

Our focus on preserving **environmental, social and economic well-being** so that it can be passed on to future generations through our products and processes.



### TECHNOLOGY

Our ability to do research, invest in processes and develop **state-of-the-art solutions** in an ever-evolving world of expertise.



### MADE IN CALEFFI

A uniqueness consisting of many details, which is what we are known for worldwide. True "**Made in Italy**" quality, the hallmark of our company.



### HISTORIC BRAND

After more than 60 years in the business, we have been included in the special register of historic brands of national interest. **We have played a part in Italy's history and we are proud of it.**

# T R A I N I N G

We have always invested in customer training and contributed to boosting know-how within the sector. CALEFFI EXPERIENCE is the result of this commitment, acting as a single umbrella under which a long list of training activities are brought into effect. First there was the wealth of technical documentation (including this brochure), and then came digital with product videos, constantly updated websites, apps, BIM libraries and 3D viewers.



GO TO OUR  
IN-DEPTH GUIDE COLLECTION



FOLLOW OUR  
YOUTUBE CHANNEL



## TABLE OF CONTENTS

• <b>NORMATIVE REFERENCES</b>	5
- Materials	5
- Performance requirements	5
- Certification	5
- Cold and hot water applications	5
• <b>PRESSURE REDUCING VALVE TYPES</b>	6
- Diaphragm pressure reducing valve	6
- Piston pressure reducing valve	7
- Comparison between diaphragm and piston	7
- Pressure limiting valve	7
- Pilot operated pressure reducing and stabilising valve	8
- Micro pressure reducing valve	8
• <b>SIZING</b>	9
- Normative references for designing domestic water systems	9
- Design flow rate calculation	9
- Selection criteria for the pressure reducing valve (velocity and pressure drop)	10
- Oversizing	11
- By-pass installation	11
- Examples of selecting pressure reducing valves	12
• <b>PRESSURE CONTROL</b>	14
- Cavitation and noise	15
- Pressure reducing valves in series (double stage reduction)	16
• <b>APPLICATION DIAGRAMS</b>	17
- Low-rise buildings	18
- Multi-storey buildings	19
- High-rise buildings	21
• <b>INSTALLATION RECOMMENDATIONS</b>	27
- General information	27
- Installation in presence of a recirculation circuit	28
• <b>MAINTENANCE</b>	30
- General rules	30
- Cartridges and strainers	30
• <b>PRESSURE CONTROL AND COMBINATION WITH OTHER COMPONENTS</b>	32
• <b>TROUBLESHOOTING</b>	34
- Pressure rise downstream of the reducing valve	34
- Water hammer	34
- Presence of impurities	34
- Troubleshooting typical problems on pressure reducing valves	35
• <b>CALEFFI PRODUCTS</b>	36

## PURPOSE OF THE GUIDE

Correct design of domestic water distribution systems is essential to ensure adequate cold and hot water supply for the users at every draw-off point, in terms of both temperature and pressure.

In this guide we will look at pressure control. The aim is to provide useful information on selecting, sizing, installing and maintaining pressure reducing valves. Different installation types will be illustrated, analysing the main aspects that must be considered when designing the entire system.

When the water system pressure is higher than required, it may lead to malfunction, noise and water waste issues. Moreover, the system pressure may vary at different times of the day. For these reasons, it is important to install devices capable of reducing the pressure to the desired value. In other cases, however, the system pressure may be too low, and it will therefore be necessary to install pressure boosting units.

It is essential to know the characteristics and operation of these devices, so that they can be sized correctly and installed at the optimal point in the system. Moreover, installation and maintenance aspects will also be analysed to prevent and identify potential faults and malfunctions.

## NORMATIVE REFERENCES

Pressure reducing valves must be made in accordance with specific product standards in relation to both performance and materials. Since these components are in contact with potable water, it is essential that the materials comply with the standards and laws that set out the hygienic requirements, in order to guarantee water quality and protect human health. There is increasing focus on these issues and the evolution of new rules highlights this.

Therefore, there is a tendency to use alloys with very low lead content and with dezincification resistant properties (low lead-DR). Products made with these materials are perfectly in line with the new regulatory provisions concerning contact with potable water. Each Country adopts specific rules regarding permissible materials and the performance that pressure reducing valves must guarantee.



### Materials

Europe	Directive (EU) 2020/2184  (recast of Directive 98/83/EC)	“Directive (EU) 2020/2184 of the European parliament and of the council of 16 December 2020 on the quality of water intended for human consumption” ( <i>Drinking Water Directive</i> ). <i>The new European Drinking Water Directive aims to improve the quality of tap water by updating the pollutant limit requirements and adding new substances to the safety standards. The new standards therefore include increasingly stringent hygiene requirements for materials in contact with drinking water (positive lists) in order to ensure that only safe substances are used in pipes and taps. Each Member State transposes the Directive with its own national regulation.</i>
North America	NSF 61	“Drinking water system components – Health effects”.
	NSF 372	“Drinking water system components – Lead Content”.
Australia	AS/NZS 4020	“Testing of products for use in contact with drinking water”.

### Performance requirements

Europe	EN 1567	“Water pressure reducing valves and combination water pressure reducing valves – Requirements and test”. <i>This standard specifies the dimensions, materials, performance requirements and hydraulic testing requirements of pressure reducing valves for both cold and hot water applications.</i>
North America	ASSE 1003	“Water pressure reducing valves for potable water distribution systems”.
	CSA B356	“Water pressure reducing valves for domestic water supply systems”.
Australia	AS 1357.2:2005	“Valves primarily for use in heated water systems - P. 2: Control valves”.

### Certification




### Cold and hot water applications

The product standards specify the performance requirements and characteristics that pressure reducing valves must have when used with both cold and hot water.

Especially in very large distribution systems, where domestic hot water production is centralised, it is necessary to reduce and control the pressure of the cold and hot water close to the user point (at the floor or single unit level).

There are products certified to the EN 1567, AS 1357.2 and ASSE 1003 standards on the market for such applications, which have been specially made with components and materials that can withstand temperatures up to 80 °C.

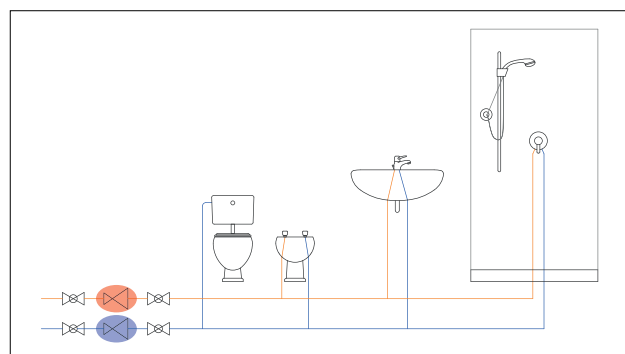

# PRESSURE REDUCING VALVE TYPES

Pressure reducing valves serve to reduce the pressure of water from the water mains to the desired value as it is often high and unstable. Their action eliminates the pressure fluctuations that can occur in pipes, typically between daytime and night-time due to the difference in water demand. Serving users with almost constant pressure ensures that the components retain their efficiency over time, prevents noise and also contributes to considerable water savings.

In this chapter, we will give an overview of the operating principle of pressure reducing valves and their various features, comparing their advantages and disadvantages.

## Diaphragm pressure reducing valve

Diaphragm pressure reducing valves are composed of:

- Adjustment control;
- Counter-spring;
- Flexible diaphragm;
- Obturator connected to the diaphragm via a stem.


The operating principle of the pressure reducing valve is based on balancing two opposing forces:

- 1- The thrust of the spring to open the flow through the cross section;
- 2- The thrust of the diaphragm to close the flow through the cross section.

The spring pushes the obturator downwards to open the pressure reducing valve, while the downstream pressure acting on the diaphragm creates a counter force that tends to return the obturator upwards to close the valve.

The pressure reducing valve operates both during supply and when the taps are closed.


The adjustment control, which only some models have, can be used to change the initial spring compression (i.e. change its preloading) and thereby give it a different thrust force. This special feature means the pressure reducing valve can be set to the desired pressure.

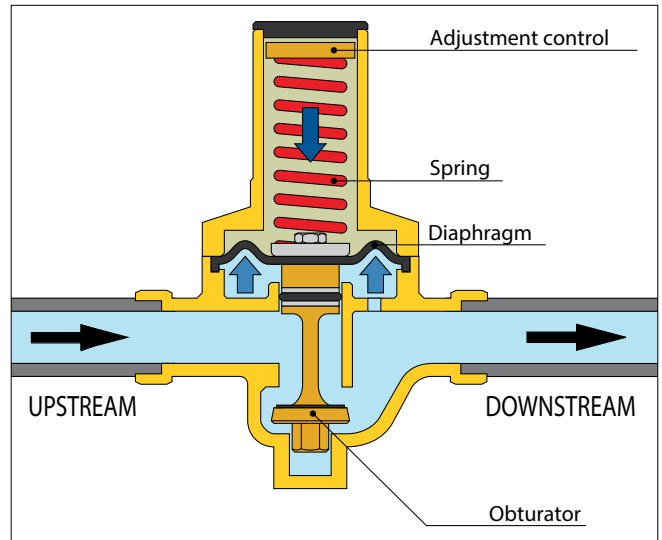

### Operation with water flow

Opening a tap on the circuit downstream of the pressure reducing valve causes a reduction in pressure below the diaphragm.


The force of the spring becomes greater than that of the diaphragm: the obturator moves downwards to open the valve to the flow of water. The greater the demand for water, the lower the pressure under the diaphragm, resulting in a greater flow of medium through the cross section.

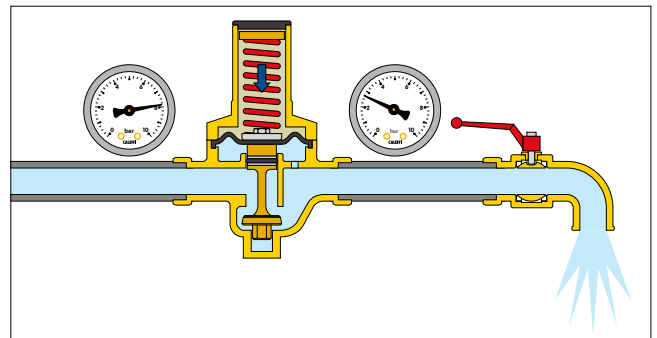

### Operation without water flow

When the draw-off outlet is closed, the downstream pressure rises and pushes the diaphragm upwards.


As a result, the obturator closes the cross section to the passage of water and maintains the pressure constant at the setting value. If the diaphragm exerts even a slightly greater force than the spring, the device closes.

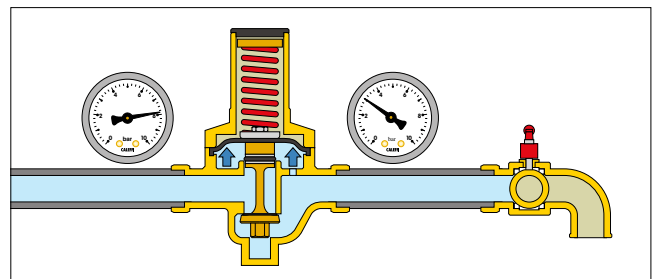

### Pressure reducing valve seat

#### Compensated seat


In pressure reducing valves with a compensated seat, the setting pressure remains constant regardless of variations in the upstream pressure. The opening thrust is counterbalanced by the force created by the closing pressure acting on the compensating piston. Since the piston has a surface area equal to the obturator one, the two forces cancel each other out.



#### Uncompensated seat

With an uncompensated seat, the pressure thrust acts only on the obturator, which tends to move downwards when the upstream pressure increases, further opening the valve to flow.



The obturator movement is therefore affected by the upstream pressure, leading to worse pressure control.



## Piston pressure reducing valve

The operating principle of piston pressure reducing valves is similar to that of diaphragm pressure reducing valves.

The difference is that the thrust created by the downstream pressure acts on the surface of a piston in these devices. Also in this case, the thrust is counterbalanced by a spring on the opposite side of the piston. The spring is preloaded according to the setting requirements.

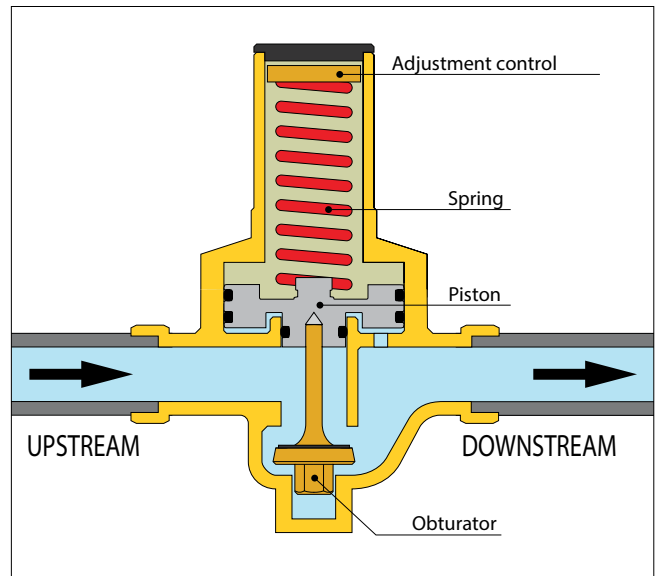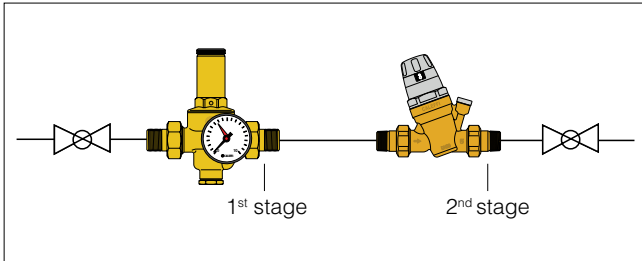


## Comparison between diaphragm and piston

Pressure reducing valve	✓	✗	Typical applications
<b>Diaphragm</b>	<ul style="list-style-type: none"> <li>• Very sensitive to pressure variations;</li> <li>• Responsive and accurate control.</li> </ul>	<ul style="list-style-type: none"> <li>• Less resistant to pressure peaks or water hammer;</li> <li>• More susceptible to dirt and temperature changes.</li> </ul>	<ul style="list-style-type: none"> <li>• Installations where pressure control must be as accurate and as responsive as possible, for example in very large buildings that require floor-level pressure control.</li> </ul>
<b>Piston</b>	<ul style="list-style-type: none"> <li>• Robust against stresses (pressure peaks or water hammer);</li> <li>• Suitable for first-stage installation;</li> <li>• More economical, depending on the model.</li> </ul>	<ul style="list-style-type: none"> <li>• Less sensitive to pressure variations;</li> <li>• Less accurate pressure control;</li> <li>• Only available with fixed setting in some cases.</li> </ul>	<ul style="list-style-type: none"> <li>• As a first stage or where the water mains pressure tends to have abrupt variations;</li> <li>• Installations in which high accuracy control is not required, for example irrigation systems, or where the pressure control accuracy is less important than the strength and reliability of the component.</li> </ul>

## Pressure limiting valve

Pressure limiting valves are fixed setting devices used to limit the pressure in a simple manner.

They usually have no strainers and are less reliable and accurate than pressure reducing valves. Pressure limiting valves are often in-line devices and are inserted directly into appliances that do not require accurate pressure control.

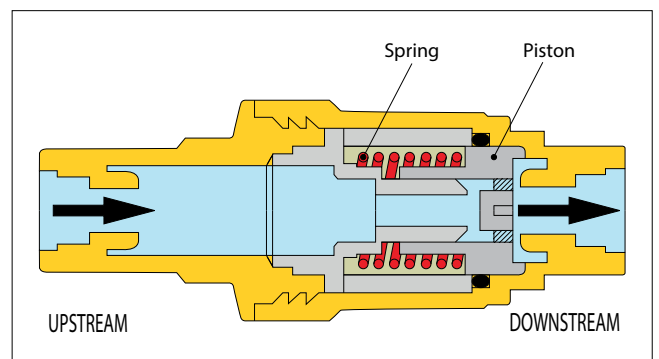


## Pilot operated pressure reducing and stabilising valve

Pilot operated pressure reducing and stabilising valves can maintain the downstream pressure at a fixed value even when the flow rate varies.

They are composed of:

1. **Main valve**, which contains an obturator connected to a diaphragm via a special stem;
2. **By-pass circuit**;
3. **Pilot pressure reducing valve**, i.e. a direct acting pressure reducing valve installed in the by-pass circuit.


The main valve replicates what happens on the pilot pressure reducing valve, so operation is controlled by the pilot pressure reducing valve. Pressure reducing valves with different functions can be made, depending on the connections.

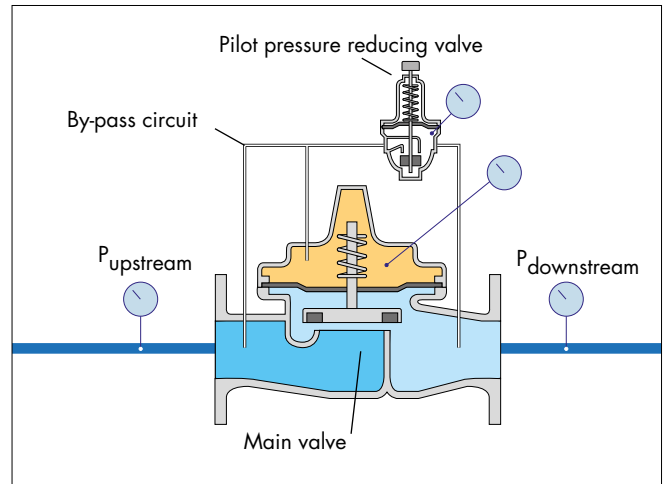

Pressure reducing valve	✓	✗	Typical applications
<b>Pilot</b>	<ul style="list-style-type: none"> <li>Continuous regulation by the pilot ensures accurate downstream pressure control;</li> <li>Pressure stabilisation with high and very variable flow rates.</li> </ul>	<ul style="list-style-type: none"> <li>Higher cost;</li> <li>More components (more frequent checks and maintenance).</li> </ul>	<ul style="list-style-type: none"> <li>Installations where pressure must be controlled accurately with high water flow rates, for example in industrial and fire-fighting applications;</li> <li>Water distribution systems with downstream or upstream pressure control (pressure maintenance).</li> </ul>

## Micro pressure reducing valve

Micro pressure reducing valves are for applications where it is necessary to reduce the mains inlet pressure and stabilise it with low flow rates. They are typically installed for service in appliances with limited space and intermittent operation. Typical applications of these micro pressure reducing valves are coffee machines or water and beverage dispensers. In addition to these applications, micro pressure reducing valves can be used in systems where pressure control is essential, especially with low flow rates.

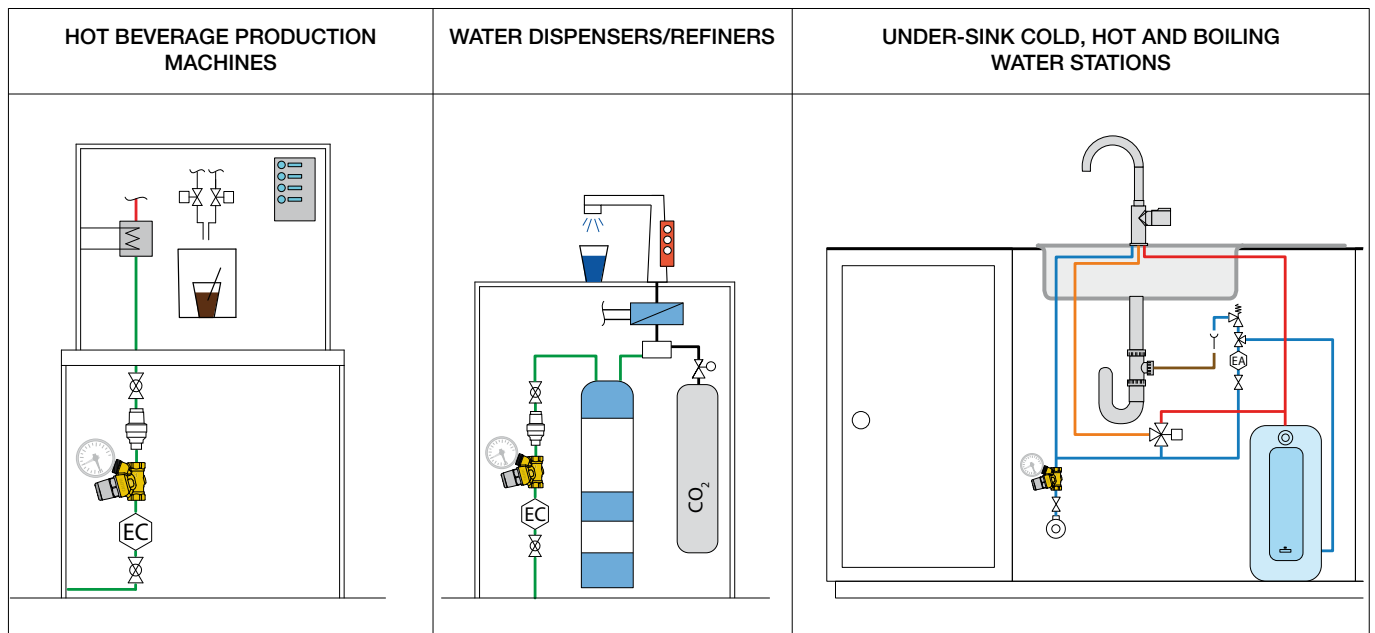



## SIZING

In order to ensure that domestic water is supplied correctly to the user points, the supply system must be sized to guarantee the design pressure and flow rate at every point.

Correct design is crucial in order to maintain and ensure the right pressure at the supply point. When the supply pressure is too low, the required flow rate to each appliance is not guaranteed. Conversely, if the pressure is too high, noise and damage to the withdrawal devices and distribution system may occur.



The national technical standards propose various calculation methods for choosing the flow rates. It should be noted that the design flow rate is not the sum of the flow rates of all the installed appliances. Simultaneous demand from all draw-off points is unlikely, and is related to the system type and application.



### Normative references for designing domestic water systems

EUROPE	<b>EN 806-3:2008</b> Specifications for installations inside buildings conveying water for human consumption. Part 3: Pipe sizing - Simplified method.
ITALY	<b>UNI 9182:2014</b> Hot and cold water supply and distribution installations. Design, installation and testing.
FRANCE	<b>NF DTU 60.11 P1-1</b> Building works — Calculation rules for sanitary installations and rainwater draining off. Part 1-1: Cold and warm sanitary networks.
GERMANY	<b>DIN 1988-300:2012</b> Codes of practice for drinking water installations. Part 300: Pipe sizing; DVGW code of practice.
UNITED KINGDOM	<b>BS 8558:2015</b> Guide to the design, installation, testing and maintenance of services supplying water for domestic use within buildings and their curtilages. Complementary guidance to BS EN 806.
U.S.A.	<b>IPC</b> (International Plumbing Code); <b>UPC</b> (Uniform Plumbing Code); <b>ASHRAE</b> Handbook.
AUSTRALIA	<b>AS/NZS 3500.1</b> Plumbing and drainage. Part 1: Water services.

### Design flow rate calculation

To size the distribution system correctly, the design flow rate must be calculated carefully to avoid the issues associated with oversizing the pipes and various system components, such as pressure reducing valves. In fact, it should not be based on all the draw-off points being active simultaneously, but only a fraction of them.

The following steps are required for correct sizing:

1. Calculate the total flow rate in relation to the number of appliances in the system and their types, referring to the technical standards and manufacturers' data;
2. Choose the simultaneous factor, or read the diagrams in the technical standards;
3. Define the design flow rate using the diagrams or factors chosen in the previous step.

The simultaneous factor calculation takes the following into account:

- User type and intended use of the building;
- Type and number of draw-off points (appliances);
- Duration of the peak time.

Usually, the more users there are, the lower the percentage of appliances open simultaneously.

Sizing methods nowadays tend to choose lower design flow rates with respect to the past.

Main reasons:

- Water savings;
- User habits;
- Hygiene;
- New appliances with flow limitation.

Once the flow rate has been defined, the permissible velocity within the pipes must be taken into account in order to size the distribution system. The pressure at the draw-off points must be guaranteed to meet the manufacturers' instructions or the technical standards.

Appliance	FLOW RATES according to EN 806-3	
	Draw-off flow rate (l/s)	Minimum flow rate (l/s)
Washbasin	0,1	0,1
Bidet	0,1	0,1
WC-cistern	0,1	0,1
Bathtub	0,4	0,3
Shower	0,2	0,15
Kitchen sink	0,2	0,15
Washing machine	0,2	0,15
Dishwasher	0,2	0,15

MAXIMUM VELOCITY according to EN 806-3	
Part of system	Maximum design velocity (m/s)
Primary distribution	2
Connecting end sections	4

RECOMMENDED PRESSURE according to EN 806-3	
Type	Limit
Maximum static pressure at the draw-off point	500 kPa (5 bar)
Minimum dynamic pressure at the draw-off point	100 kPa (1 bar)
<i>Recommended operating range at the draw-off point</i>	<i>150–300 kPa (1,5–3 bar)</i>

### Selection criteria for pressure reducing valves (velocity and pressure drop)

When choosing the most suitable pressure reducing valve, it is advisable to consider a flow velocity range of 1–2 m/s. This range is based on the need to prevent noise and consequently also rapid wear of the components and appliances. The flow velocity depends on the pass-through flow rate and the pipe cross section as follows:

$$V = \frac{10^3 \cdot 4}{\pi} \cdot \frac{G_{design}}{(DN)^2}$$

Where:


- V = flow velocity (m/s);
- G<sub>design</sub> = medium flow rate (l/s);
- DN = nominal diameter (mm).

Note that, the size of the pressure reducing valve must be selected to obtain a flow velocity within the specified range (1–2 m/s). Alternatively, the appropriate diagrams in the technical product documentation can be used.




The pressure drop is obtained from the graphs in the technical documentation by intersecting the design flow rate with the curve for the diameter chosen previously. With respect to the set pressure with a flow rate of zero, the downstream pressure therefore decreases by a value equal to the pressure drop.

It is important to have a progressive pressure drop, a sudden decrease can cause problems with certain flows.

#### Velocity

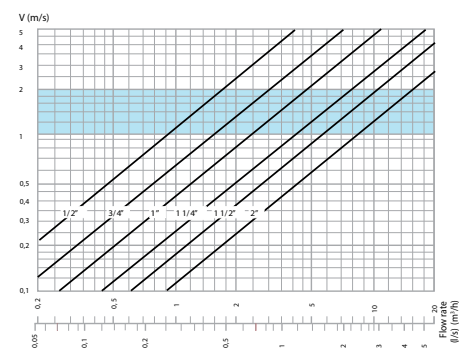

#### Pressure drop

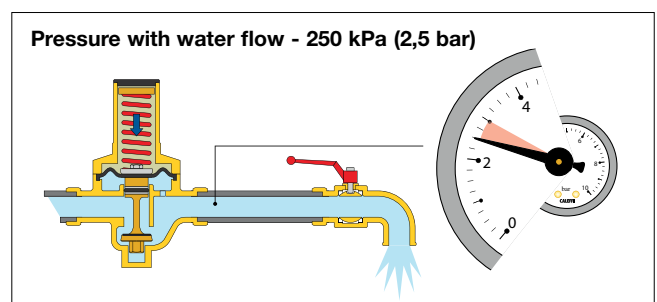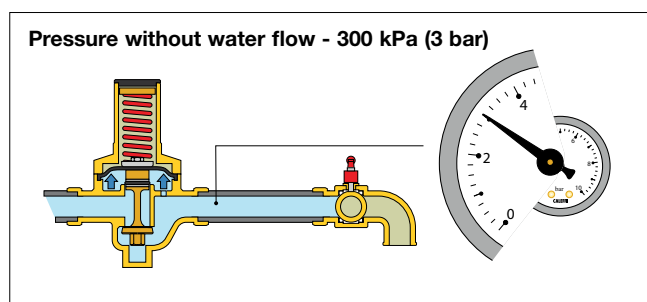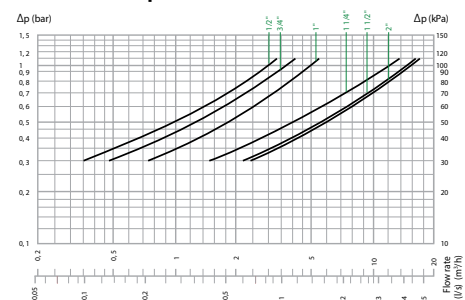

The pressure drop at the design flow rate must always be taken into account when choosing the pressure reducing valve. In addition to verifying the velocity, it is always necessary to check that the pressure drop is not too high, otherwise a larger size or a different type of pressure reducing valve must be chosen.

## Oversizing

Oversizing occurs when the chosen pressure reducing valve is too large in relation to the flow rate through it under nominal operating conditions. An error of this type causes the pressure to be regulated incorrectly.

<b>Design errors</b>	<b>Choice of simultaneous factor</b> Error due to choosing simultaneous factors that are incorrect or in any case not in line with the characteristics and intended use of the building.
	<b>Selection based on pipe size</b> Error due to choosing a pressure reducing valve based only on the system pipe diameter, especially when retrofitting in older, often oversized systems.

Always make appropriate design flow calculations before choosing the pressure reducing valve and other components to be installed.

## By-pass installation


Sizing the pressure reducing valve according to the design flow rate sometimes leads to operating problems when there is low flow rate demand. This condition may arise because of the time of use during the day or due to specific system uses.

<b>Operation outside the working range</b>	The pressure reducing valve operates with the obturator almost fully closed, and may be unable to regulate the outlet pressure correctly, causing it to fluctuate. The diaphragm becomes unstable resulting in erratic behaviour at low flow rates. This can lead to noise and vibration problems, which are then transmitted to the whole system.
--	---


The solution to this issue is to install two pressure reducing valves in parallel (by-pass) to ensure a stable downstream pressure, even at low flow rates. System operation is fully automatic, based on the actual flow rate.

### Installation logic with by-pass pressure reducing valves

- Main pressure reducing valve:  
Sized according to the design flow rate.
- By-pass pressure reducing valve:  
Set to approximately 50–70 kPa (0,5–0,7 bar) higher than the setting of the main pressure reducing valve, and sized according to the minimum flow rate demand of the system. The minimum flow rate demand can be assumed to be 20–30 % of the design flow rate.

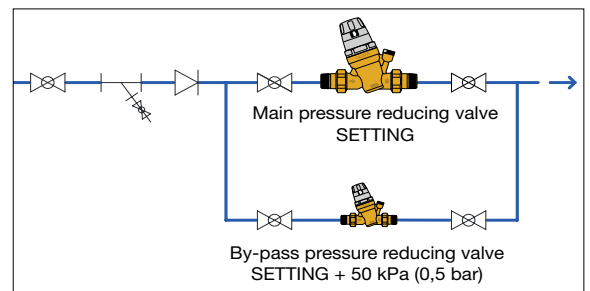

### Operation

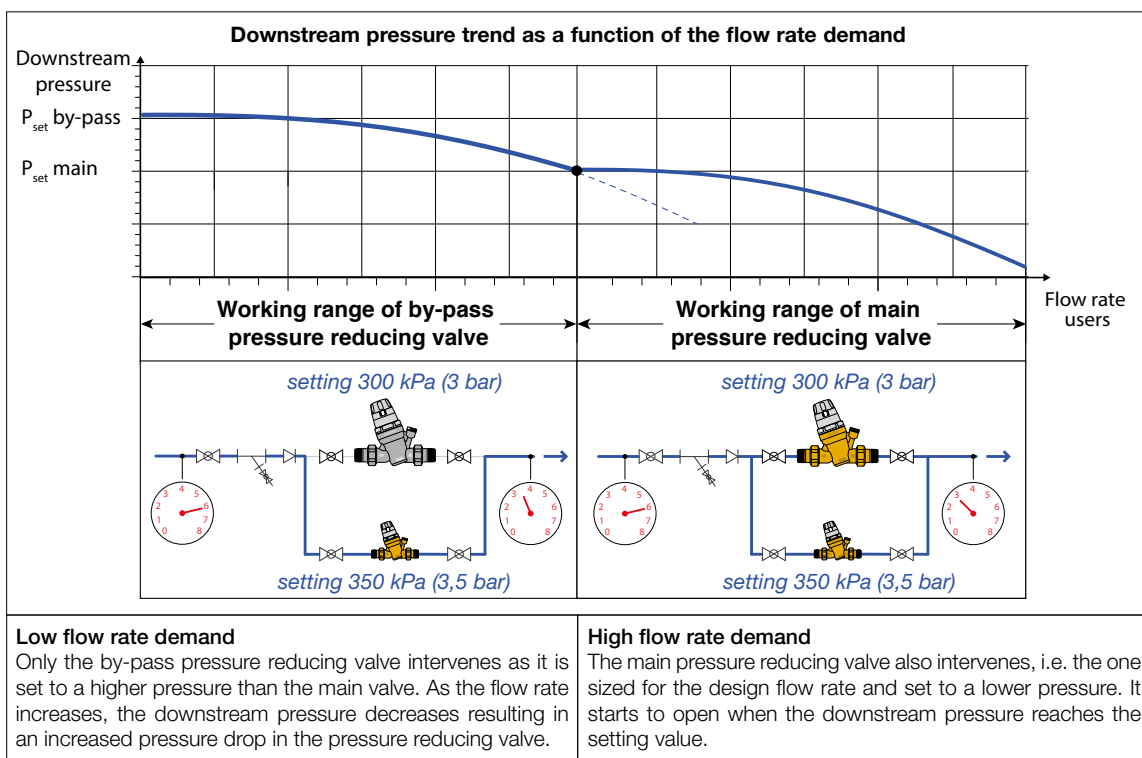

With this system solution, the pressure is fully regulated when the system is operating with a low flow rate. At the same time, the correct pressure is also guaranteed when the design flow rate is used. It is a very useful solution for systems with high flow rate demands during the day or at specific times, and significantly lower flow rates at other times.

## Examples of selecting pressure reducing valves

### RESIDENTIAL CASE (according to EN 806-3)

Below are some examples of calculations according to the EN 806-3 standard for:

- **Single house**, composed of 2 bathrooms and 1 kitchen;
- **Apartment block** composed of:
  - 10 apartments (bathroom and kitchen);
  - 20 apartments (bathroom and kitchen).

To calculate the total flow rate, the installed appliances are considered, with the flow rates of each appliance.


$$G_{\text{total}} = n * G_{\text{sink}} + n * G_{\text{bidet}} + n * G_{\text{wc}} + n * G_{\text{bath}} + n * G_{\text{shower}} + n * G_{\text{dishwasher}} + n * G_{\text{washing machine}}$$

Where n is the number of appliances of each type.

Appliance	Unit flow rate	SINGLE HOUSE	APARTMENT
		No. of appliances	No. of appliances
Sink	0,2 l/s	1	1
Washbasin	0,1 l/s	2	1
Bidet	0,1 l/s	2	1
WC-cistern	0,1 l/s	2	1
Bathtub	0,4 l/s	1	1
Shower	0,2 l/s	1	0
Washing machine	0,2 l/s	1	1
Dishwasher	0,2 l/s	1	1
TOTAL FLOW RATE		1,8 l/s	1,3 l/s

	SINGLE HOUSE	APARTMENT BLOCK	
		10 APARTMENTS	20 APARTMENTS
Total flow rate	1,8 l/s	13 l/s	26 l/s
Design flow rate	0,65 l/s	1,3 l/s	1,6 l/s
Simultaneous factor	36,1 %	10 %	6,2 %


#### Velocity

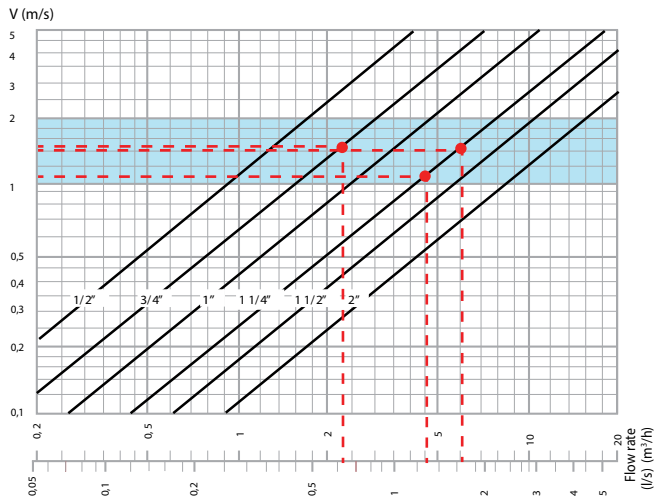

**Choice of pressure reducing valve** (according to the velocity and pressure drop graphs)

	SINGLE HOUSE	APARTMENT BLOCK	
		10 APARTMENTS	20 APARTMENTS
DN	20	32	32
$\Delta p$	70 kPa (0,7 bar)	55 kPa (0,55 bar)	60 kPa (0,60 bar)

#### Pressure drop

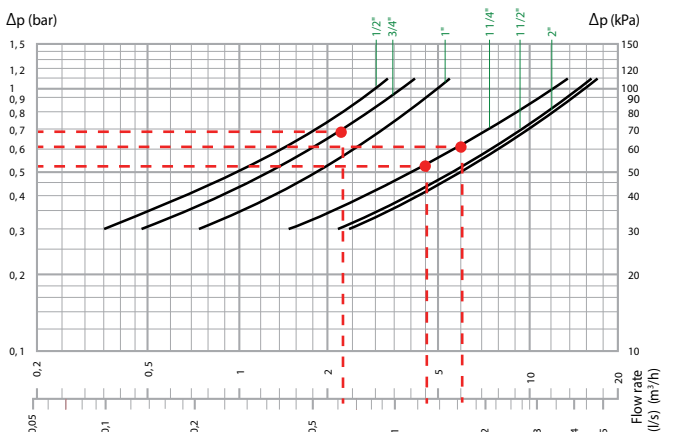

**COMMERCIAL CASE (according to DIN 1988-300)**

Below are some examples of calculations according to the DIN 1988-300 standard for:

- **Hotel** composed of:
  - 10 rooms;
  - 25 rooms;
  - 50 rooms.

Appliance	Unit flow rate	HOTEL ROOM
		No. of appliances
Washbasin	0,07 l/s	1
Bidet	0,07 l/s	1
WC-cistern	0,13 l/s	1
Bathtub	0,15 l/s	0
Shower	0,15 l/s	1
TOTAL FLOW RATE		0,57 l/s

	HOTEL		
	10 ROOMS	25 ROOMS	50 ROOMS
Total flow rate	5,7 l/s	14,25 l/s	28,5 l/s
Design flow rate	1,48 l/s	2,38 l/s	3,36 l/s
Simultaneous factor	26 %	16,7 %	11,8 %

**Choice of pressure reducing valve** (according to the velocity and pressure drop graphs)

	HOTEL		
	10 ROOMS	25 ROOMS	50 ROOMS
DN	32	40	50
$\Delta p$	60 kPa (0,60 bar)	65 kPa (0,65 bar)	80 kPa (0,80 bar)


**Choice of by-pass pressure reducing valve**

Proceeding with the example of the 50-room hotel, we define how to choose and set the by-pass reducing valve based once again on the velocity. Since this application requires high flow rates at specific times and significantly lower ones at other times, it is necessary to install a by-pass pressure reducing valve.

The main pressure reducing valve is DN 50. The by-pass pressure reducing valve is sized for a lower flow rate than the design flow rate; we assume a flow rate of 25 % in the example.  
We always recommend adjusting it on site during commissioning to ensure all devices operate in the best condition.




50-ROOM HOTEL	
Total flow rate	28,5 l/s
Design flow rate	3,36 l/s
Simultaneous factor	11,8 %
DN MAIN PRESSURE REDUCING VALVE Set to 300 kPa (3 bar)	50 (2")
$\Delta p$	80 kPa (0,80 bar)

BY-PASS PRESSURE REDUCING VALVE - Set to 370 kPa (3,7 bar)	
Minimum flow rate demand is 25 % of the design flow rate	0,84 l/s
By-pass pressure reducing valve DN	25 (1")
$\Delta p$	65 kPa (0,65 bar)

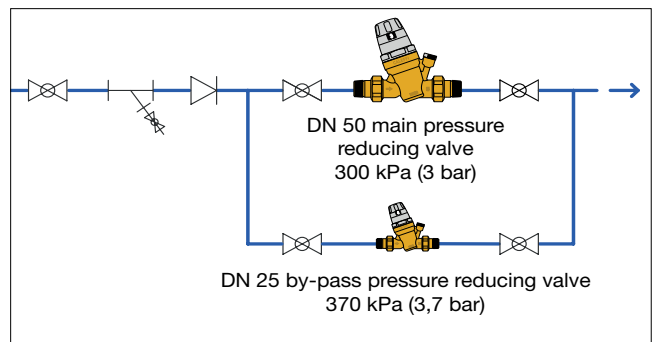

# PRESSURE CONTROL

Pressure reducing valves serve to maintain the pressure and ensure that it is correct at the draw-off point, usually in the range 150 to 300 kPa (1,5 to 3 bar). Always refer to the technical data sheets provided by the appliance manufacturers to verify if they have different working ranges.

LOW PRESSURE	OPTIMAL PRESSURE	EXCESSIVE PRESSURE
$0 \text{ kPa} < P < 150 \text{ kPa}$ ( $0 \text{ bar} < P < 1,5 \text{ bar}$ )	$150 \text{ kPa} \leq P \leq 300 \text{ kPa}$ ( $1,5 \text{ bar} \leq P \leq 3 \text{ bar}$ )	$P > 300 \text{ kPa}$ ( $P > 3 \text{ bar}$ )
		



Two main conditions can occur in domestic water systems:


1. The mains pressure is too high and therefore must be reduced at the inlet;
2. The mains pressure is too low and must be increased with pressure boosting units.

In high-rise buildings, the thrust needed to ensure the required pressure at the higher floors may be too high for the lower floors, so the best compromise has to be found between the pressure boosting unit setting and the locations of the pressure reducing valves.

In buildings with several floors, the hydrostatic height results in an equivalent decrease in the pressure available at the taps.

The hydrostatic pressure trend is shown below, considering each floor to be 3 metres high, therefore with a  $\Delta P$  of 30 kPa (0,3 bar) from one floor to the next.

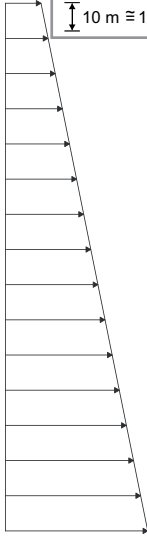Building specifications	Pressure trend without pressure reducing valves	Pressure trend with pressure reducing valves																																																																			
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr><td style="width: 30px;">floor 15</td><td style="width: 100px;">45 m</td></tr> <tr><td>floor 14</td><td>42 m</td></tr> <tr><td>floor 13</td><td>39 m</td></tr> <tr><td>floor 12</td><td>36 m</td></tr> <tr><td>floor 11</td><td>33 m</td></tr> <tr><td>floor 10</td><td>30 m</td></tr> <tr><td>floor 9</td><td>27 m</td></tr> <tr><td>floor 8</td><td>24 m</td></tr> <tr><td>floor 7</td><td>21 m</td></tr> <tr><td>floor 6</td><td>18 m</td></tr> <tr><td>floor 5</td><td>15 m</td></tr> <tr><td>floor 4</td><td>12 m</td></tr> <tr><td>floor 3</td><td>9 m</td></tr> <tr><td>floor 2</td><td>6 m</td></tr> <tr><td>floor 1</td><td>3 m</td></tr> <tr><td>floor 0</td><td>0 m</td></tr> </table>	floor 15	45 m	floor 14	42 m	floor 13	39 m	floor 12	36 m	floor 11	33 m	floor 10	30 m	floor 9	27 m	floor 8	24 m	floor 7	21 m	floor 6	18 m	floor 5	15 m	floor 4	12 m	floor 3	9 m	floor 2	6 m	floor 1	3 m	floor 0	0 m	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr><td style="background-color: #d9ead3;">150 kPa (1,5 bar)</td></tr> <tr><td style="background-color: #d9ead3;">180 kPa (1,8 bar)</td></tr> <tr><td style="background-color: #d9ead3;">210 kPa (2,1 bar)</td></tr> <tr><td style="background-color: #d9ead3;">240 kPa (2,4 bar)</td></tr> <tr><td style="background-color: #d9ead3;">270 kPa (2,7 bar)</td></tr> <tr><td style="background-color: #d9ead3;">300 kPa (3 bar)</td></tr> <tr><td style="background-color: #f4cccc;">330 kPa (3,3 bar)</td></tr> <tr><td style="background-color: #f4cccc;">360 kPa (3,6 bar)</td></tr> <tr><td style="background-color: #f4cccc;">390 kPa (3,9 bar)</td></tr> <tr><td style="background-color: #f4cccc;">420 kPa (4,2 bar)</td></tr> <tr><td style="background-color: #f4cccc;">450 kPa (4,5 bar)</td></tr> <tr><td style="background-color: #f4cccc;">480 kPa (4,8 bar)</td></tr> <tr><td style="background-color: #f4cccc;">510 kPa (5,1 bar)</td></tr> <tr><td style="background-color: #f4cccc;">540 kPa (5,4 bar)</td></tr> <tr><td style="background-color: #f4cccc;">570 kPa (5,7 bar)</td></tr> <tr><td style="background-color: #f4cccc;">600 kPa (6 bar)</td></tr> </table> <div style="text-align: center; margin-top: 10px;">  <p style="font-size: small; margin: 0;">Hydrostatic pressure <math>\updownarrow</math> 10 m <math>\cong</math> 100 kPa (1 bar)</p> </div>	150 kPa (1,5 bar)	180 kPa (1,8 bar)	210 kPa (2,1 bar)	240 kPa (2,4 bar)	270 kPa (2,7 bar)	300 kPa (3 bar)	330 kPa (3,3 bar)	360 kPa (3,6 bar)	390 kPa (3,9 bar)	420 kPa (4,2 bar)	450 kPa (4,5 bar)	480 kPa (4,8 bar)	510 kPa (5,1 bar)	540 kPa (5,4 bar)	570 kPa (5,7 bar)	600 kPa (6 bar)	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr><td style="background-color: #d9ead3;">150 kPa (1,5 bar)</td></tr> <tr><td style="background-color: #d9ead3;">180 kPa (1,8 bar)</td></tr> <tr><td style="background-color: #d9ead3;">210 kPa (2,1 bar)</td></tr> <tr><td style="background-color: #d9ead3;">240 kPa (2,4 bar)</td></tr> <tr><td style="background-color: #d9ead3;">270 kPa (2,7 bar)</td></tr> <tr><td style="background-color: #d9ead3;">300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> <tr><td style="background-color: #d9ead3;">✕ 300 kPa (3 bar)</td></tr> </table> <div style="text-align: center; margin-top: 10px;">  </div>	150 kPa (1,5 bar)	180 kPa (1,8 bar)	210 kPa (2,1 bar)	240 kPa (2,4 bar)	270 kPa (2,7 bar)	300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)	✕ 300 kPa (3 bar)
floor 15	45 m																																																																				
floor 14	42 m																																																																				
floor 13	39 m																																																																				
floor 12	36 m																																																																				
floor 11	33 m																																																																				
floor 10	30 m																																																																				
floor 9	27 m																																																																				
floor 8	24 m																																																																				
floor 7	21 m																																																																				
floor 6	18 m																																																																				
floor 5	15 m																																																																				
floor 4	12 m																																																																				
floor 3	9 m																																																																				
floor 2	6 m																																																																				
floor 1	3 m																																																																				
floor 0	0 m																																																																				
150 kPa (1,5 bar)																																																																					
180 kPa (1,8 bar)																																																																					
210 kPa (2,1 bar)																																																																					
240 kPa (2,4 bar)																																																																					
270 kPa (2,7 bar)																																																																					
300 kPa (3 bar)																																																																					
330 kPa (3,3 bar)																																																																					
360 kPa (3,6 bar)																																																																					
390 kPa (3,9 bar)																																																																					
420 kPa (4,2 bar)																																																																					
450 kPa (4,5 bar)																																																																					
480 kPa (4,8 bar)																																																																					
510 kPa (5,1 bar)																																																																					
540 kPa (5,4 bar)																																																																					
570 kPa (5,7 bar)																																																																					
600 kPa (6 bar)																																																																					
150 kPa (1,5 bar)																																																																					
180 kPa (1,8 bar)																																																																					
210 kPa (2,1 bar)																																																																					
240 kPa (2,4 bar)																																																																					
270 kPa (2,7 bar)																																																																					
300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					
✕ 300 kPa (3 bar)																																																																					

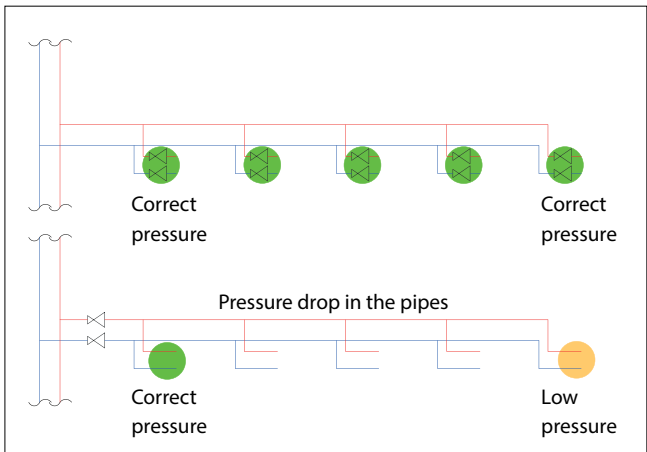


When choosing the correct location for the pressure reducing valves, it is also important to consider the pressure drops due to dynamic effects. In particular, we must prevent the most favorable areas from subtracting pressure from the farthest areas. When the pipes are undersized and long, the pressure drops due to dynamic effects become considerable, especially in the farthest units. The pressures are lower at these points and may be insufficient for the user.


When choosing the pressure reducing valve, it is necessary to consider that it can vibrate and cause noise in certain operating conditions. In some systems, to avoid problems related to cavitation and noise, specific solutions have to be adopted to ensure that the pressure reducing valves can operate correctly within their working range.

## Cavitation and noise

A key consideration when choosing and locating pressure reducing valves is cavitation, the cause of many noise and vibration issues. It is typical of hydraulic systems and consists of the formation of small vapour bubbles, which can damage pipes and components as a result of rapid collapse. Noise in pressure reducing valves may be a clear indication that they are operating in improper working conditions. If the pressure reduction ratio, i.e. the ratio between upstream pressure and downstream pressure, is too high, the water becomes very fast in the restricted cross section. This generates a local pressure drop (according to Bernoulli's equation) until the vapour pressure of the liquid is reached.

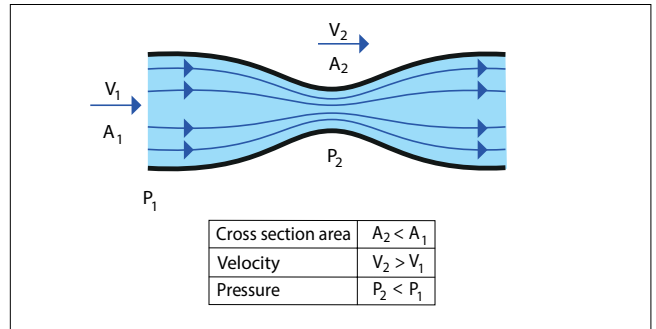


**DETAIL OF THE OBTURATOR**

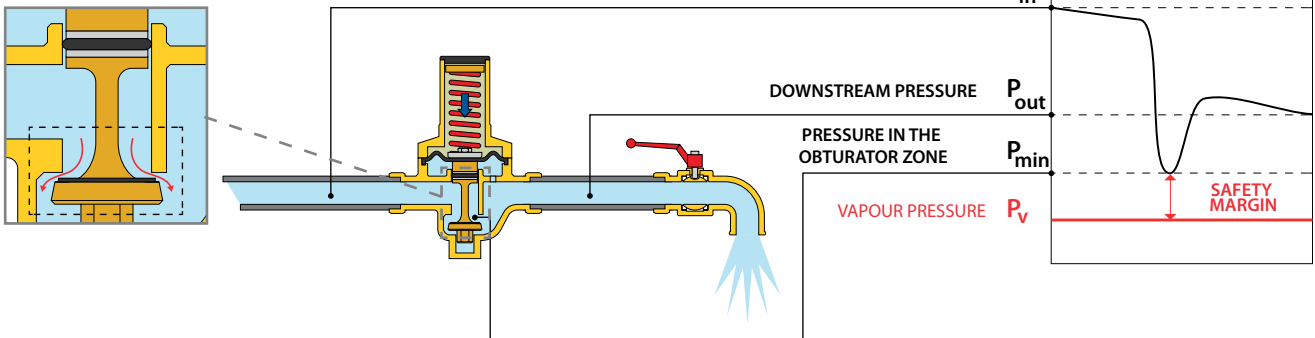


This condition causes the liquid to change to the gaseous phase, forming bubbles that contain vapour. When the bubbles implode, it causes pressure fluctuations charged with impact energy. Together with the high water velocity in the gap between the seat and obturator, this can compromise the components in the pressure reducing valve, creating mechanical vibrations, noise and material erosion. The phenomenon is increased if the water contains dissolved air.

Vapour pressure varies with water temperature. There is a much greater risk of cavitation in hot water as the vapour pressure is higher. For example, the vapour pressure ( $P_v$ ) at 60 °C is about 20 times greater than at 10 °C.

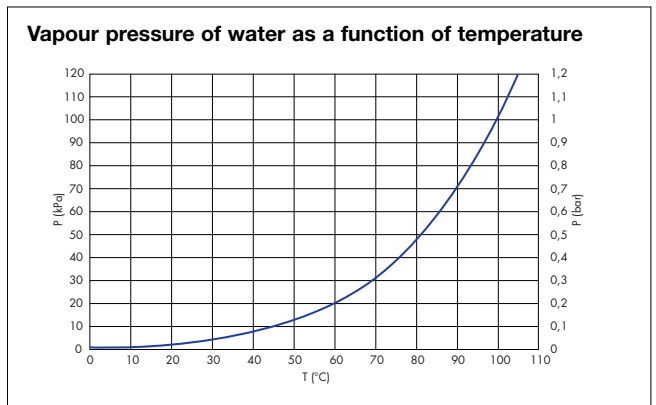

### Cavitation diagram

To minimise the risk of cavitation in the pressure reducing valve, we strongly recommend referring to the working conditions specified in the cavitation diagram.

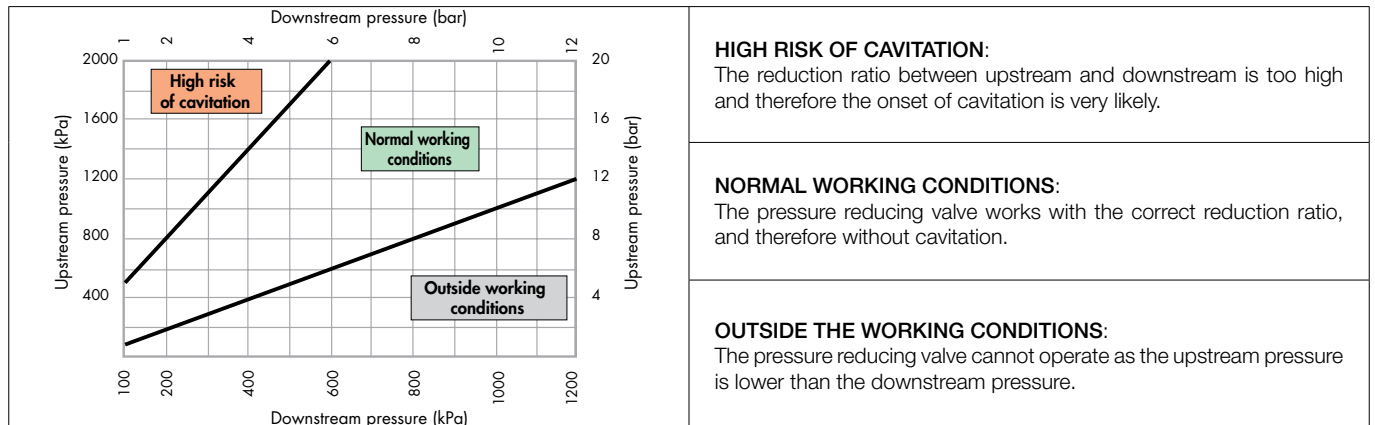

Numerous factors and variable conditions can affect the behaviour of pressure reducing valves, including system pressure, temperature, presence of air, flow rate and velocity. We recommend keeping the ratio between the upstream and downstream pressures ideally at 2:1 and no higher than 3:1 (maximum recommended pressure reduction ratio). In such conditions, the risk of cavitation is reduced to a minimum, nevertheless this does not completely exclude potential effects due to the other numerous factors present inside the system during operation.


## Pressure reducing valves in series (double stage reduction)

In system applications for which a high pressure must be guaranteed in order to supply the users at the top floors, some measures must be taken to ensure that the pressure reducing valves at the bottom floors do not work in conditions at risk of cavitation.



This situation can also occur when the mains pressure is already very high. One of the solutions that can be adopted is to install several pressure reducing valves in series so that they share the pressure drop.

Assuming an inlet pressure of 1500 kPa (15 bar) and a desired pressure of 300 kPa (3 bar) at the users, the reduction ratio is too high (5:1). Therefore the following must be installed:

- a **first stage** pressure reducing valve to perform an initial pressure reduction: generally it can be a device with less accurate regulation, but with high mechanical resistance since it is subject to the mains pressure peaks and variations;
- a **second stage** pressure reducing valve installed in series with the first to reach the desired pressure: generally it must be able to guarantee accurate regulation to the users, and is also less subject to pressure peaks and fluctuations since its operation is protected by the first stage.

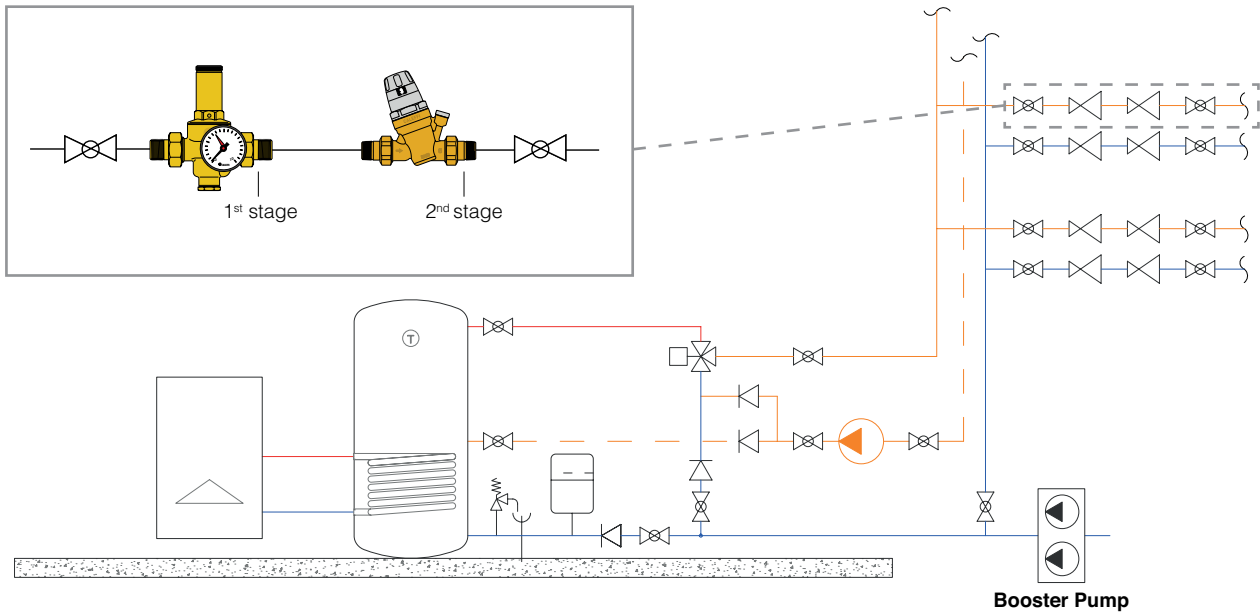


### Reduction ratio

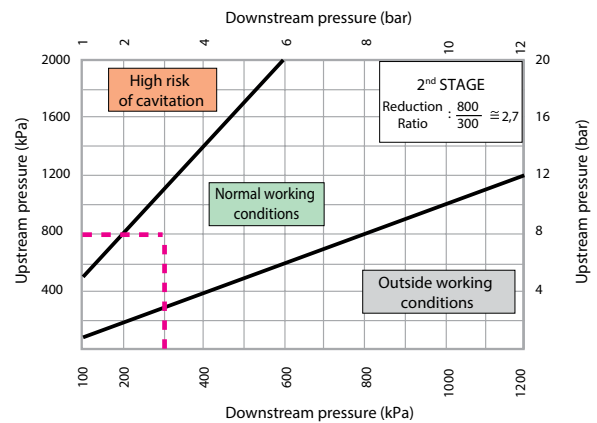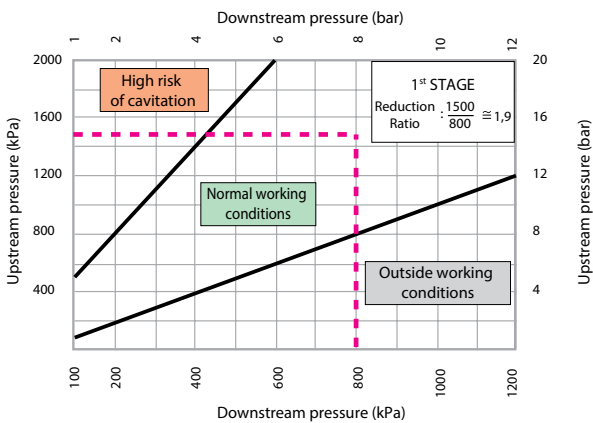

### Combined by-pass/series application

In some installations, it is also possible to opt for more complex system solutions, consisting of pressure reducing valves in parallel and pressure reducing valves in series. This ensures that the pressure is controlled optimally in both design flow rate conditions and low flow rate conditions. Series installation also allows low reduction ratios. For the sake of simplicity, the diagram shows only the domestic hot water circuit, but the same considerations can also be applied to the cold water circuit.

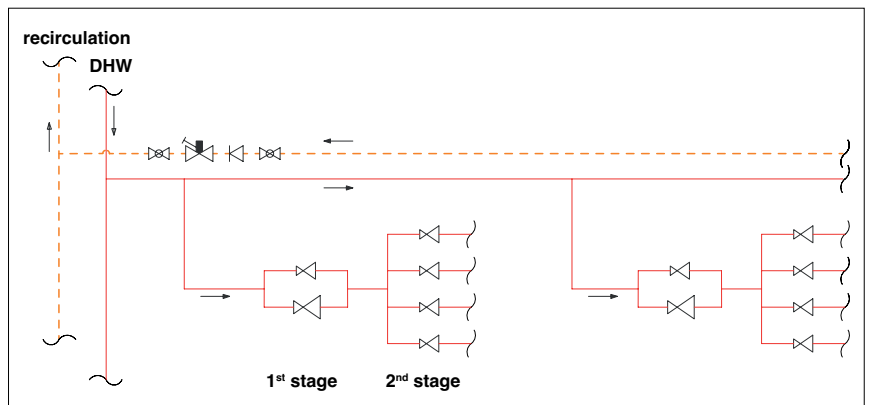




## APPLICATION DIAGRAMS

It is important to define the best points for installing the pressure reducing valves at the design stage. In general, local control is the optimal solution as it can ensure correct pressure regulation at the individual users. However, for reasons of simplicity and cost, this solution is not always feasible, and so pressure control by zone is used. The installation and maintenance aspects of these devices must also be assessed, especially in very complex buildings.

Below are some typical installation diagrams for pressure reducing valves: small domestic applications, medium-sized multi-storey buildings and high-rise buildings.


The advantages and disadvantages of each application are highlighted, focusing on pressure management, operation and installation of the pressure reducing valves.

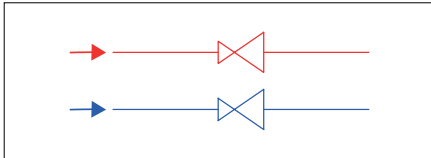

### NOTE:

Due to hygiene and design reasons, the cold water pipes should be installed in a separated shaft with respect to the hot and recirculation water pipes.

In the next diagrams, for simplicity of reading, the pipes will be represented in common runways.

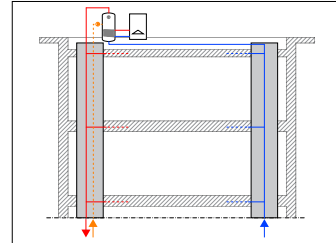

### Low-rise buildings



Installation that generally feature distribution networks that are not too large, typically serving two or three floors, in which fairly limited pressures are reached.

- DIAGRAM 1: Two-floor residential building.

### Multi-storey buildings




Buildings from 10 to 15 floors in which it is necessary to assess the pressure variation due to the height differences between the various floors. In the diagrams below, the pressure variation is assumed to be 30 kPa (0,3 bar), considering each floor to be 3 m high.

It is necessary to verify that the pressure on the top and bottom floors remains within the optimal range of 150 kPa < P < 300 kPa (1,5 bar < P < 3 bar).

- DIAGRAM 2: Multi-storey without pressure boosting unit;
- DIAGRAM 3: Multi-storey with pressure boosting unit.

### High-rise buildings

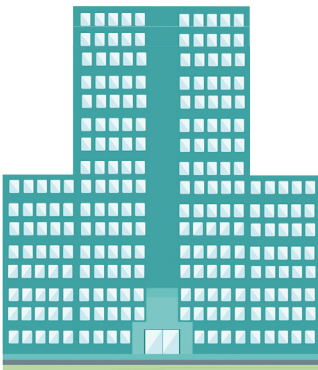


Buildings over 15 floors in which there may be multiple solutions. A first choice concerns the distribution system, which can be from the bottom or from the top, exploiting gravity cisterns or generators in the plant rooms at the top floors. Buildings of this type usually require pressure boosting systems, which can create excessive pressure at some points in the system. Series pressure reducing valves are installed to prevent cavitation. Regulations in some Countries require operating pressures of up to 1000 kPa (10 bar). In these cases, the solution is to divide the building into zones at different pressures.

- DIAGRAM 4: 40 floors with a single plant room;
- DIAGRAM 5: 40 floors with separate plant rooms;
- DIAGRAM 6: 40 floors with separate plant rooms and storage cistern;
- DIAGRAM 7: 40 floors with pressurised DHW production on the roof;
- DIAGRAM 8: 40 floors with pressurised DHW production on the roof and floor-level recirculation;
- DIAGRAM 9: 40 floors with cisterns at atmospheric pressure.

## Low-rise buildings

DIAGRAM 1	TWO-FLOOR RESIDENTIAL BUILDING
<b>SYSTEM FEATURES</b>	<ul style="list-style-type: none"> <li>• Plant room with DHW storage;</li> <li>• Single riser distribution from the bottom and recirculation circuit in the main riser.</li> </ul>
<b>FOCUS ON REDUCING VALVES</b>	<ul style="list-style-type: none"> <li>• Pressure reducing valves installed at the supply point;</li> <li>• Setting pressure generally kept between 250 kPa and 300 kPa (2,5 and 3 bar).</li> </ul>
<b>ADVANTAGES</b>	<ul style="list-style-type: none"> <li>• Simple, economical solution with single control over cold and hot water. Balanced cold and hot water pressures;</li> <li>• Water storage and all installed components protected against excessive mains pressures.</li> </ul>
<b>DISADVANTAGES</b>	<ul style="list-style-type: none"> <li>• Overall control, not local.</li> </ul>

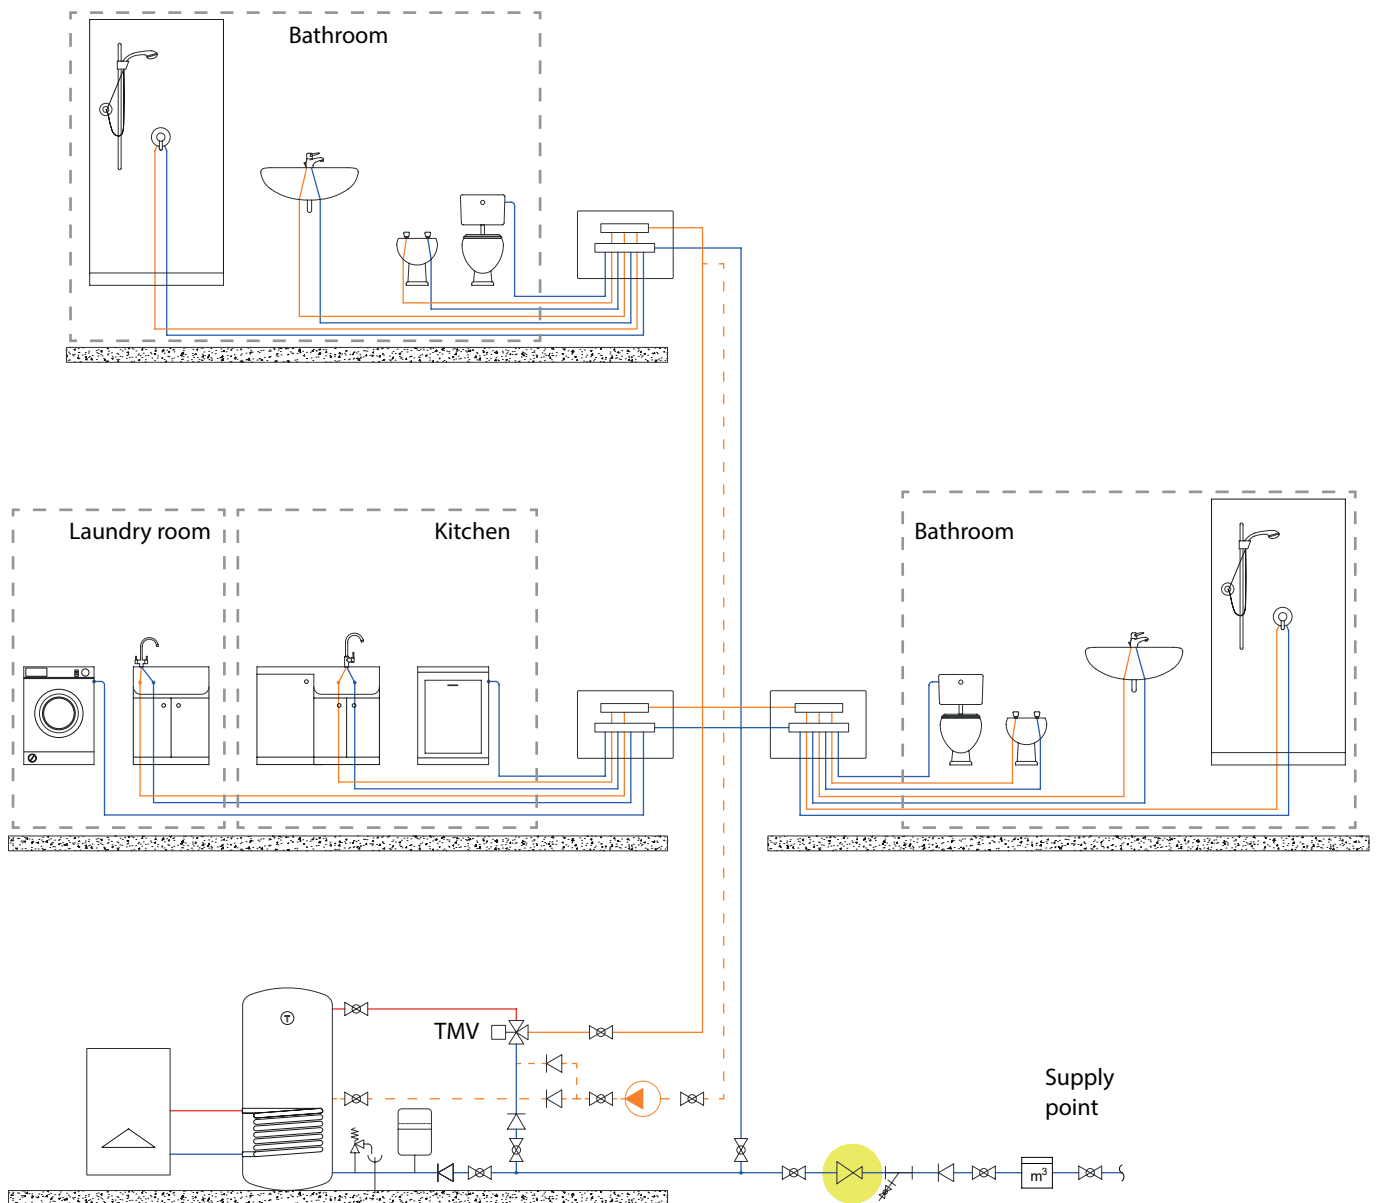

## Multi-storey buildings

DIAGRAM 2	MULTI-STOREY WITHOUT PRESSURE BOOSTING UNIT
<b>SYSTEM FEATURES</b>	<ul style="list-style-type: none"> <li>Sufficient mains pressure available;</li> <li>Multi-riser distribution;</li> <li>DHW production within each unit.</li> </ul>
<b>FOCUS ON REDUCING VALVES</b>	<ul style="list-style-type: none"> <li>Pressure reducing valve installed only on the riser supplying the lower floors. Pressure reducing valve sized for the design flow rate of the units on the riser.</li> </ul>
<b>ADVANTAGES</b>	<ul style="list-style-type: none"> <li>Simple, economical solution with single pressure reducing valve.</li> </ul>
<b>DISADVANTAGES</b>	<ul style="list-style-type: none"> <li>Pressure varies from floor to floor, 300 kPa (3 bar) at the bottom floors and 150 kPa (1,5 bar) at the worst-case floor;</li> <li>Pressures at higher floors are not controlled and are subject to the water mains pressure variations;</li> <li>Single pressure reducing valve, which may work outside the design conditions for which it was chosen at low flow rates.</li> </ul>


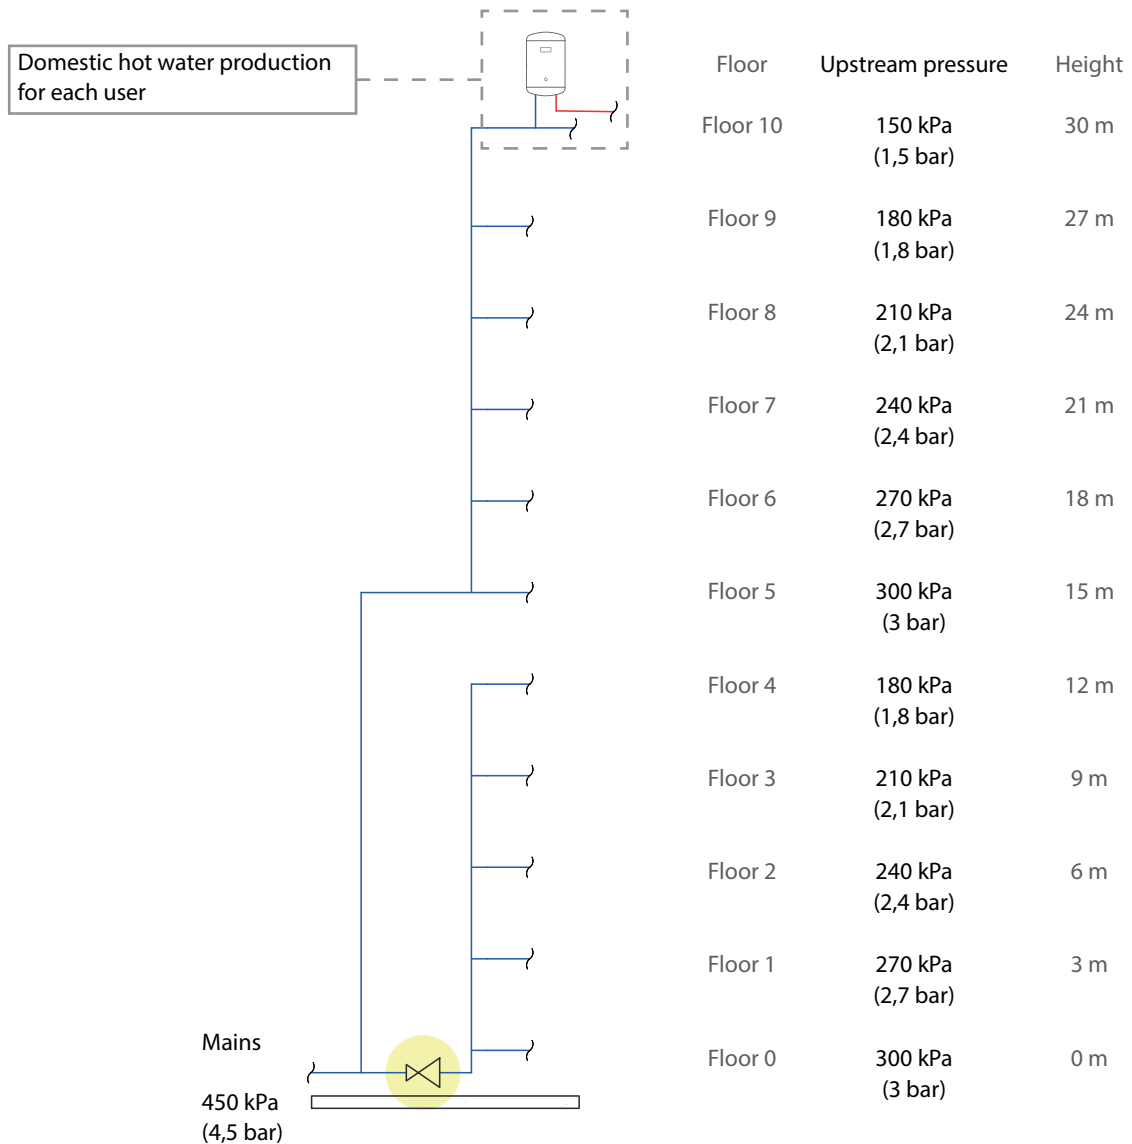


DIAGRAM 3	MULTI-STOREY WITH PRESSURE BOOSTING UNIT
SYSTEM FEATURES	<ul style="list-style-type: none"> <li>Insufficient mains pressure available, e.g. mains pressure of 250 kPa (2,5 bar);</li> <li>Installation of a pressure boosting unit;</li> <li>Central DHW production;</li> <li>Single riser distribution from the bottom and recirculation circuit in the main riser.</li> </ul>
FOCUS ON REDUCING VALVES	<ul style="list-style-type: none"> <li>Pressure reducing valve at each floor branch, on both cold and hot water.</li> </ul>
ADVANTAGES	<ul style="list-style-type: none"> <li>Floor-level pressure control, inlet pressure reduced to 300 kPa (3 bar);</li> <li>Single distribution risers for cold and hot water.</li> </ul>
DISADVANTAGES	<ul style="list-style-type: none"> <li>Higher number of devices to maintain and check, in technical cupboards.</li> </ul>

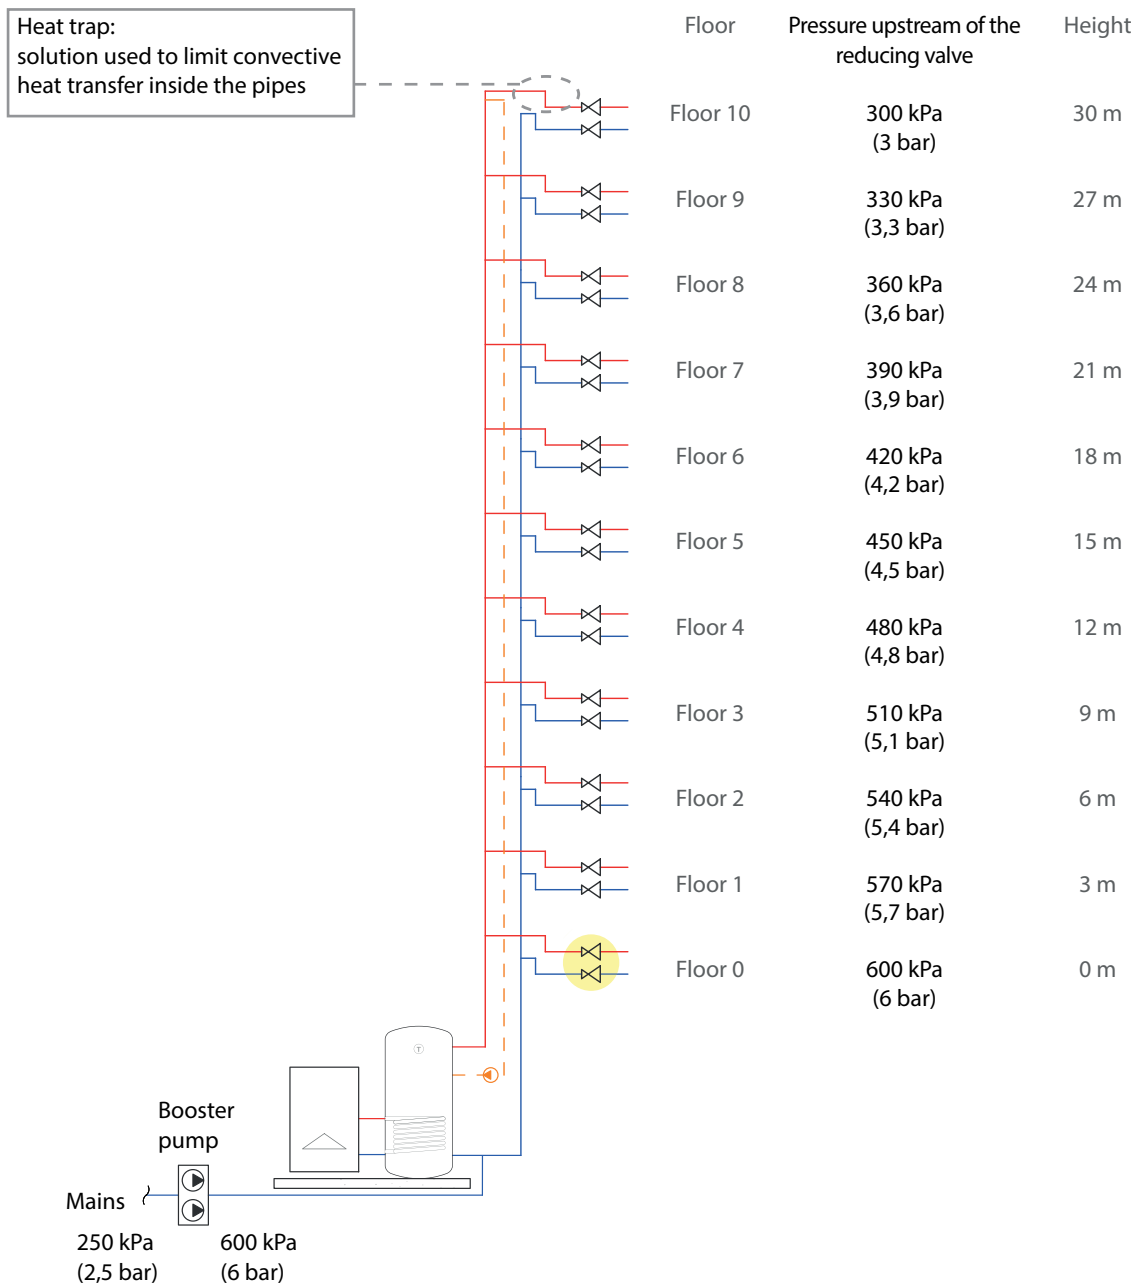

## High-rise buildings

DIAGRAM 4	40-FLOOR BUILDING WITH A SINGLE PLANT ROOM	
<b>SYSTEM FEATURES</b>	<ul style="list-style-type: none"> <li>• Plant room at the base;</li> <li>• Central DHW production by means of a heat exchanger;</li> <li>• Single riser distribution from the bottom and recirculation circuit in the main riser.</li> </ul>	
<b>FOCUS ON REDUCING VALVES</b>	<ul style="list-style-type: none"> <li>• <b>Pressure reducing valve per zone</b></li> </ul>	<ul style="list-style-type: none"> <li>• <b>Pressure reducing valves per floor branch</b></li> </ul>
<b>ADVANTAGES</b>	<ul style="list-style-type: none"> <li>• Simple, economical solution with a single riser;</li> <li>• Single recirculation circuit, no balancing required;</li> <li>• Single plant room at the base. No intermediate floors/plant rooms.</li> </ul>	
	<ul style="list-style-type: none"> <li>• Simple, economical solution with single pressure reducing valve per zone.</li> </ul>	<ul style="list-style-type: none"> <li>• Floor-level pressure control, inlet pressure reduced to 3 bar.</li> </ul>
<b>DISADVANTAGES</b>	<ul style="list-style-type: none"> <li>• High maximum pressures, lower floors subject to the entire hydrostatic head;</li> <li>• Need for pressure reducing valves in series at the lower floors (reduction ratios higher than the established limits);</li> <li>• Components suitable for working at high pressures, in some Countries pressures must not exceed 1000 kPa (10 bar);</li> <li>• Pressure too high for a storage, a heat exchanger is required.</li> </ul>	
	<ul style="list-style-type: none"> <li>• Zone pressure varies (300 kPa (3 bar) at the bottom floors and 180 kPa (1,8 bar) at the top floor).</li> </ul>	<ul style="list-style-type: none"> <li>• More devices to maintain and check, in technical cupboards</li> </ul>

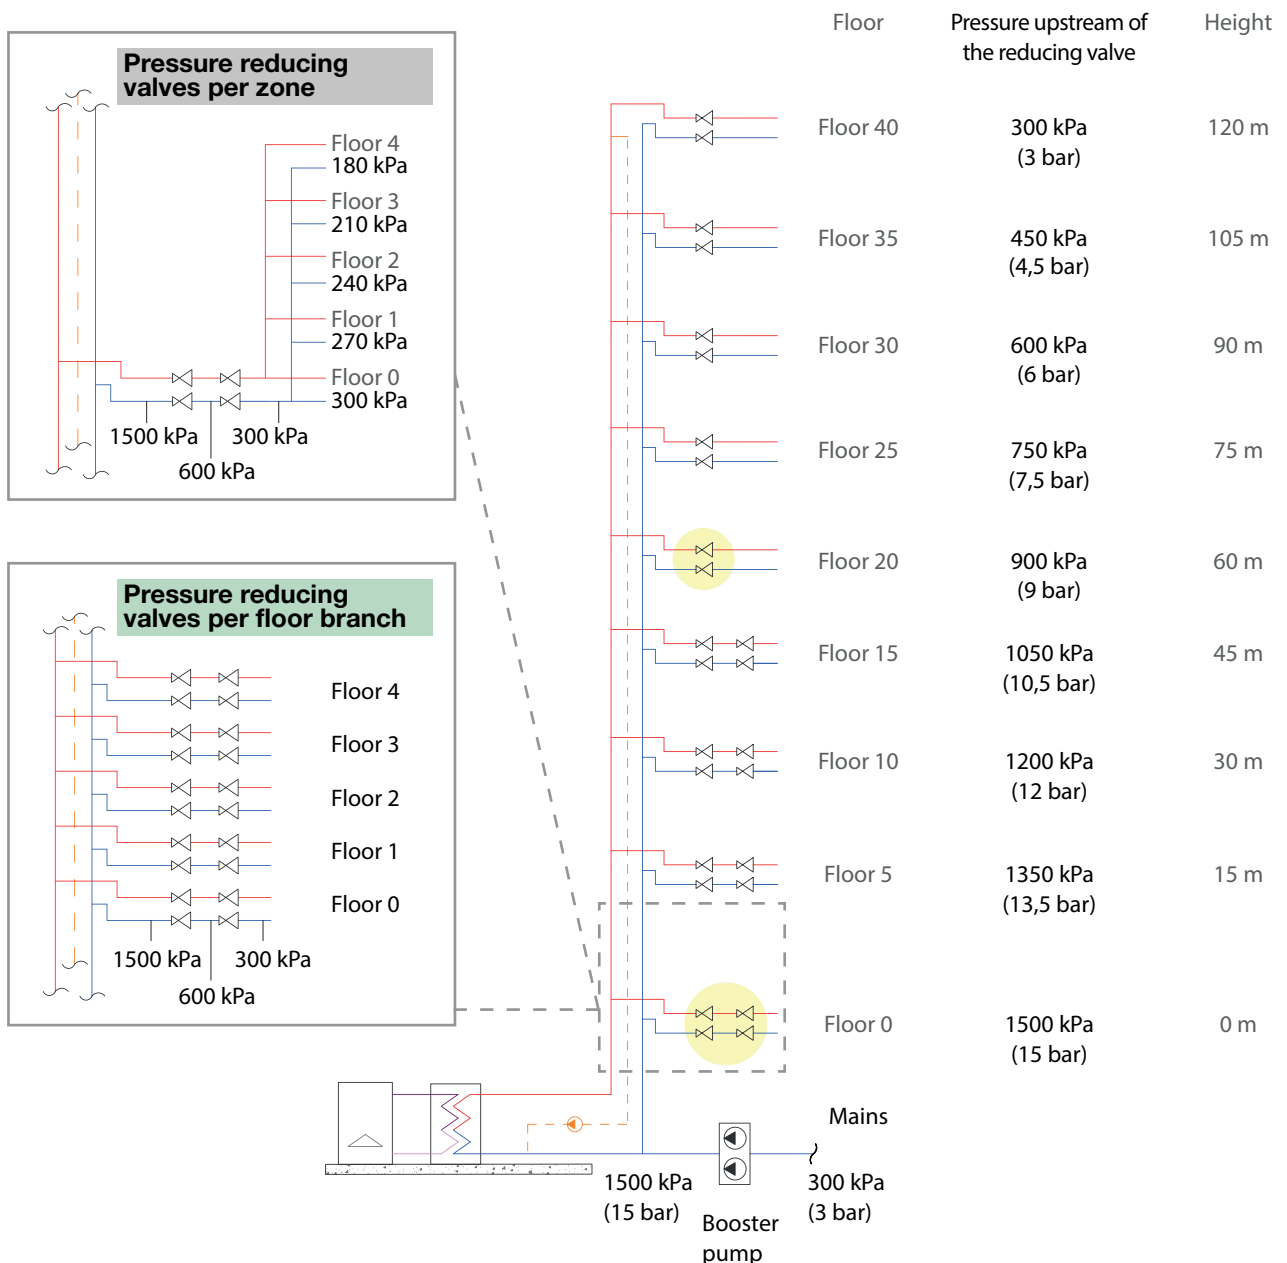


DIAGRAM 5	40-FLOOR BUILDING WITH SEPARATE PLANT ROOMS
SYSTEM FEATURES	<ul style="list-style-type: none"> <li>Multi-riser distribution from the bottom;</li> <li>Two plant rooms for DHW production.</li> </ul>
FOCUS ON REDUCING VALVES	<ul style="list-style-type: none"> <li>Pressure reducing valves per zone, no need for double stage.</li> </ul>
ADVANTAGES	<ul style="list-style-type: none"> <li>Double riser limits the pressures acting on the components and storages;</li> <li>Limited number of pressure reducing valves;</li> <li>Double stage not required as the reduction ratios are within the established limits.</li> </ul>
DISADVANTAGES	<ul style="list-style-type: none"> <li>Zone pressure varies (300 kPa (3 bar) at the bottom floors and 180 kPa (1,8 bar) at the top floor);</li> <li>Use of two pressure boosting units for the two distribution risers;</li> <li>Two plant rooms and recirculation circuits with dedicated circulation pumps.</li> </ul>

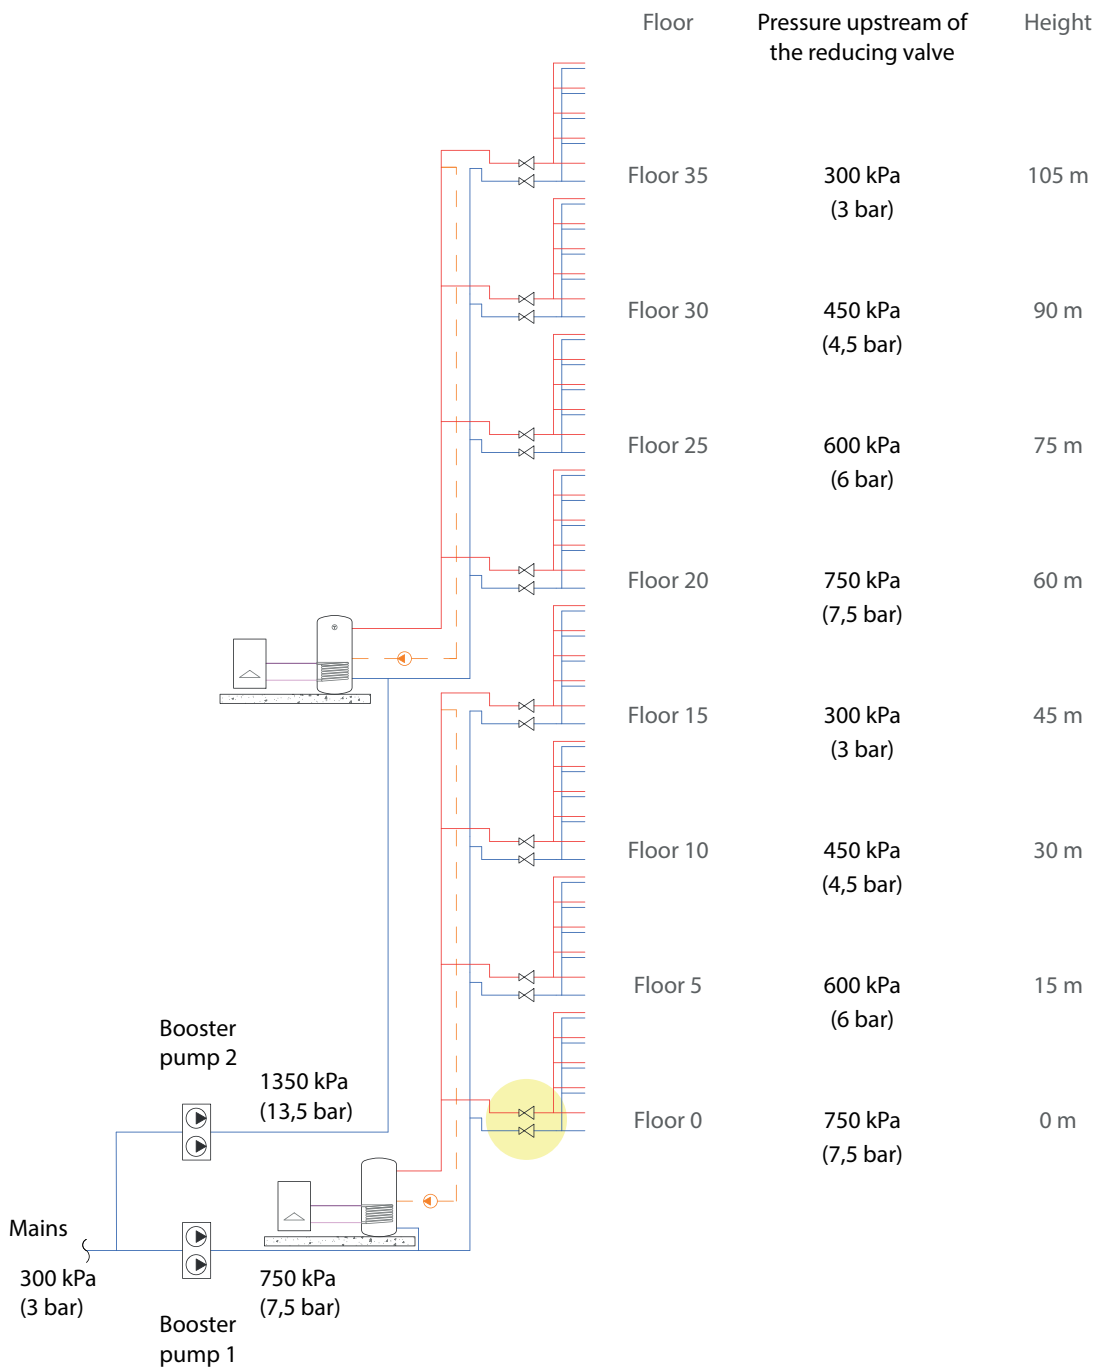


DIAGRAM 6	40-FLOOR BUILDING WITH SEPARATE PLANT ROOMS AND STORAGE CISTERN
SYSTEM FEATURES	<ul style="list-style-type: none"> <li>Multi-riser distribution from the bottom;</li> <li>Storage cistern at atmospheric pressure and heat exchanger for DHW production;</li> <li>Transfer pump to fill the cistern with water.</li> </ul>
FOCUS ON REDUCING VALVES	<ul style="list-style-type: none"> <li>Pressure reducing valves per zone, no need for double stage.</li> </ul>
ADVANTAGES	<ul style="list-style-type: none"> <li>Double riser limits the pressures acting on the components and heat exchangers;</li> <li>Limited number of pressure reducing valves;</li> <li>Double stage not required as the reduction ratios are within the established limits;</li> <li>Cistern with reserve function and transfer pump (no need for a high-performance pump);</li> <li>Central thermal production.</li> </ul>
DISADVANTAGES	<ul style="list-style-type: none"> <li>Zone pressure varies (300 kPa (3 bar) at the bottom floors and 180 kPa (1,8 bar) at the top floor);</li> <li>Use of two pressure boosting units for the two distribution risers;</li> <li>Plant floor for cistern and DHW production heat exchanger;</li> <li>Very large setup and load, need for dedicated spaces (floor unavailable for commercial use).</li> </ul>

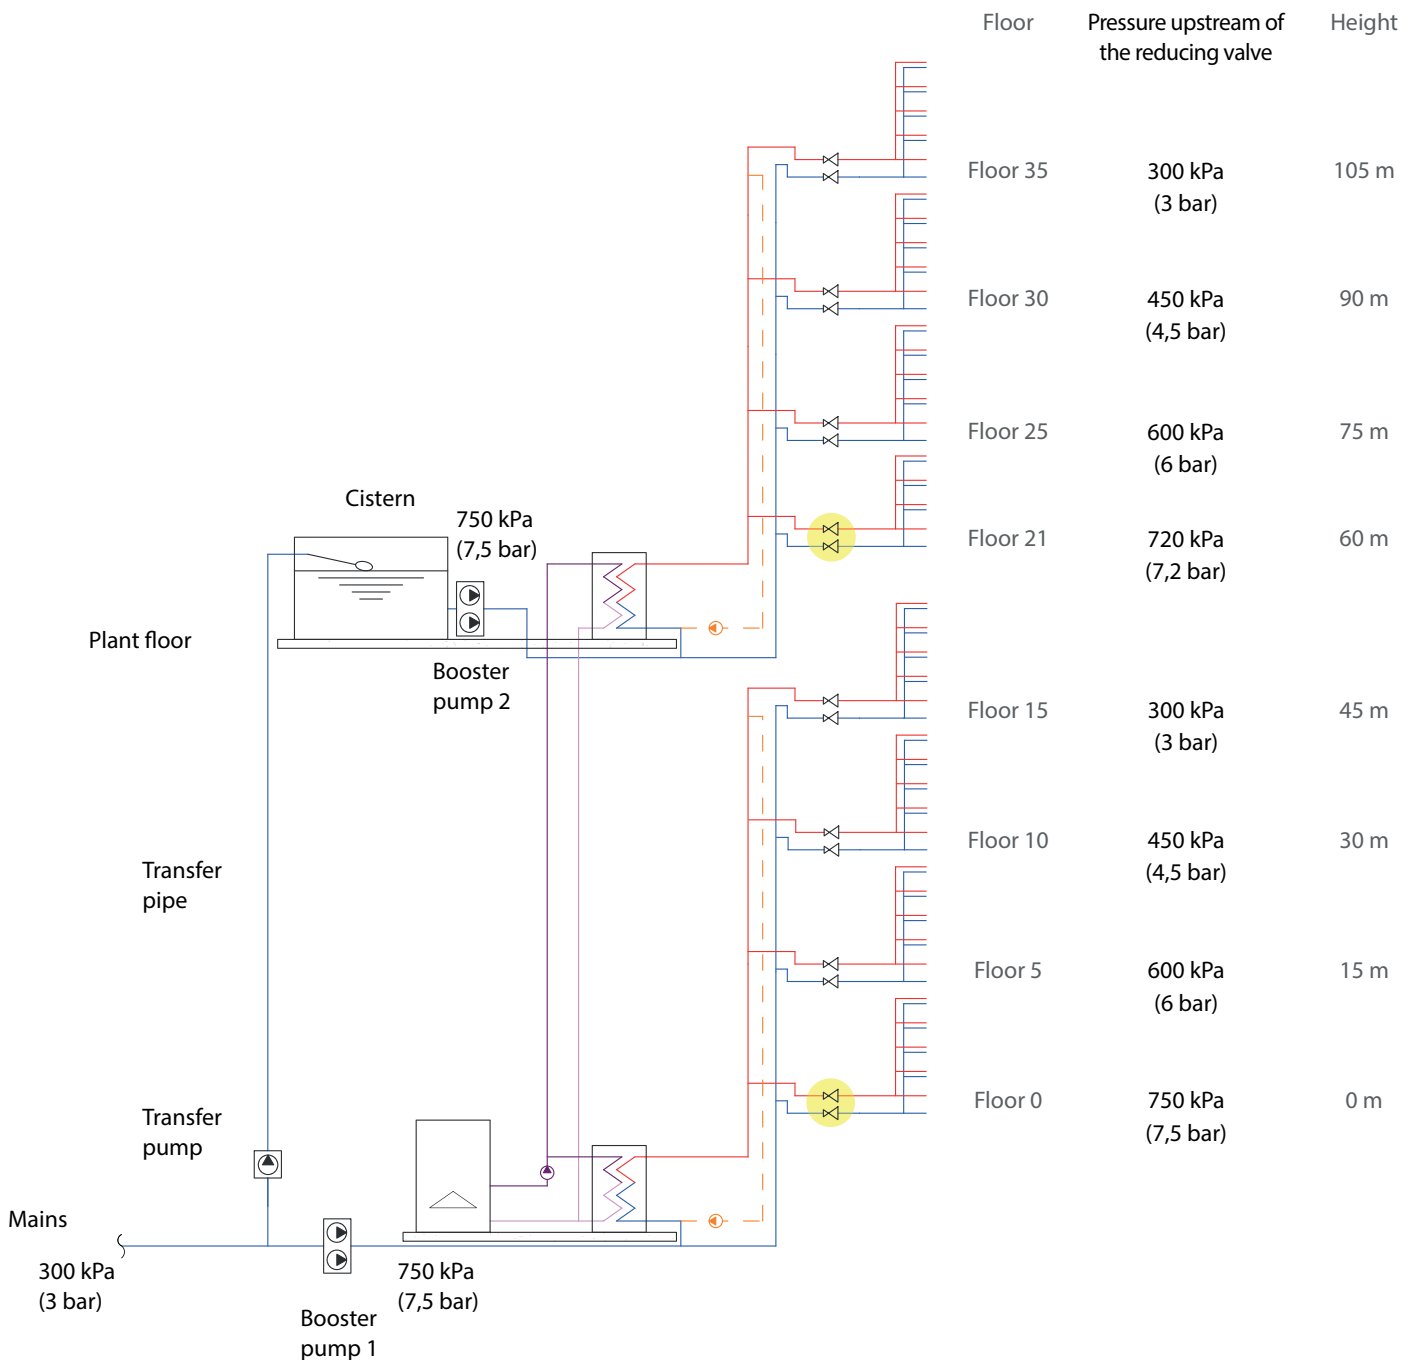


DIAGRAM 7	40-FLOOR BUILDING WITH PRESSURISED DHW PRODUCTION ON ROOF
<b>SYSTEM FEATURES</b>	<ul style="list-style-type: none"> <li>• Plant floor on the roof;</li> <li>• Cascaded generators with unvented storages at about 200 kPa (2 bar);</li> <li>• Single riser cold water distribution from the bottom;</li> <li>• Single riser hot water distribution from the top and recirculation circuit in the main riser.</li> </ul>
<b>FOCUS ON REDUCING VALVES</b>	<ul style="list-style-type: none"> <li>• Pressure reducing valves per floor branch, with double stage at the lower floors;</li> <li>• Pressure reducing valves not required at the top floors.</li> </ul>
<b>ADVANTAGES</b>	<ul style="list-style-type: none"> <li>• Pressure control at 300 kPa (3 bar) at floor level, except for the higher floors;</li> <li>• Limited pressure to storages for DHW production and to related components (not subject to the hydrostatic head);</li> <li>• Single plant floor with simple installation and maintenance;</li> <li>• Single distribution risers for cold and hot water.</li> </ul>
<b>DISADVANTAGES</b>	<ul style="list-style-type: none"> <li>• Need for pressure reducing valves in series at the lower floors;</li> <li>• More devices to maintain and check, in technical cupboards;</li> <li>• Pipes and components suitable for working at high pressures, in some Countries pressures must not exceed 1000 kPa (10 bar).</li> </ul>

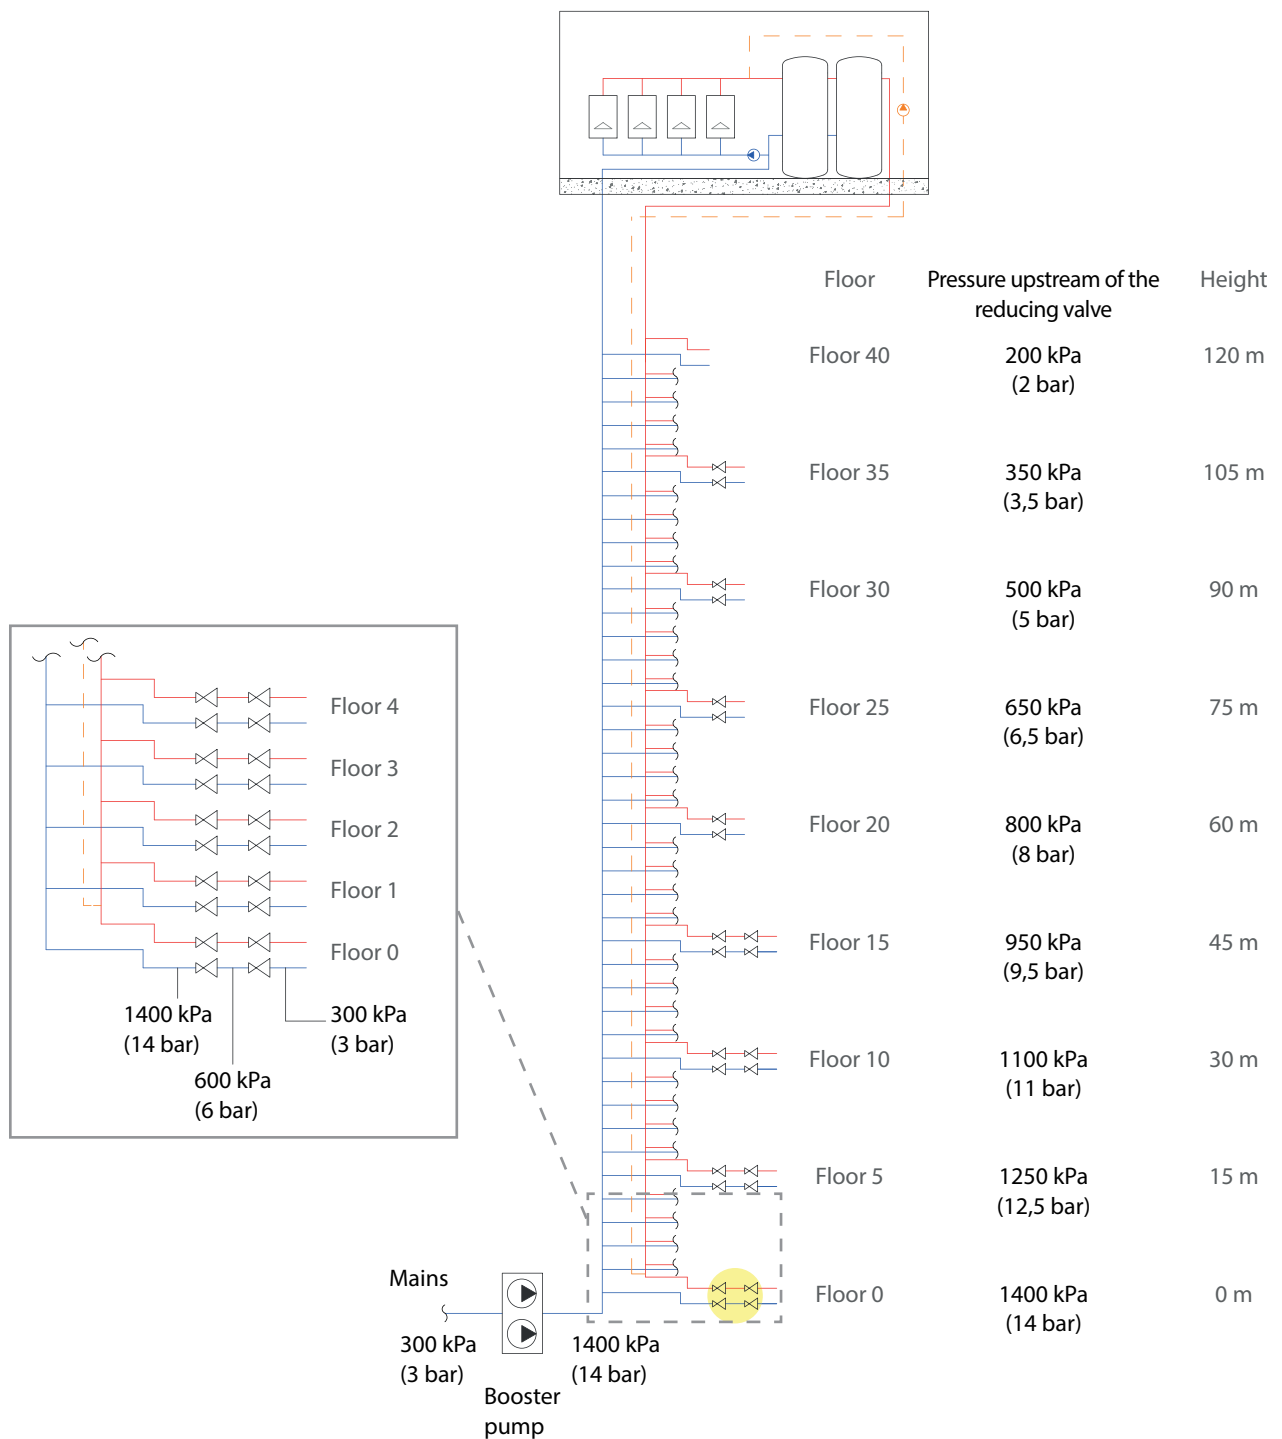




DIAGRAM 8	40-FLOOR BUILDING WITH PRESSURISED DHW PRODUCTION ON ROOF AND FLOOR-LEVEL RECIRCULATION
SYSTEM FEATURES	<ul style="list-style-type: none"> <li>Plant floor on the roof;</li> <li>Cascaded generators with unvented storages at about 200 kPa (2 bar);</li> <li>Very wide horizontal distribution;</li> <li>Single riser cold water distribution from the bottom;</li> <li>Single riser hot water distribution from the top and floor-level recirculation circuit.</li> </ul>
FOCUS ON REDUCING VALVES	<ul style="list-style-type: none"> <li>Pressure reducing valves for each unit, with double stage at the lower floors.</li> </ul>
ADVANTAGES	<ul style="list-style-type: none"> <li>Local pressure control, inlet pressure at each unit reduced to 300 kPa (3 bar);</li> <li>Limited pressure to storages for DHW production and to related components (not subject to the hydrostatic head);</li> <li>Single plant floor and single distribution risers for cold and hot water;</li> <li>Balanced floor-level recirculation.</li> </ul>
DISADVANTAGES	<ul style="list-style-type: none"> <li>Need pressure reducing valves in series at the lower floors;</li> <li>More devices to maintain and check, in technical cupboards;</li> <li>Pipes and components suitable for working at high pressures, in some Countries pressures must not exceed 1000 kPa (10 bar).</li> </ul>


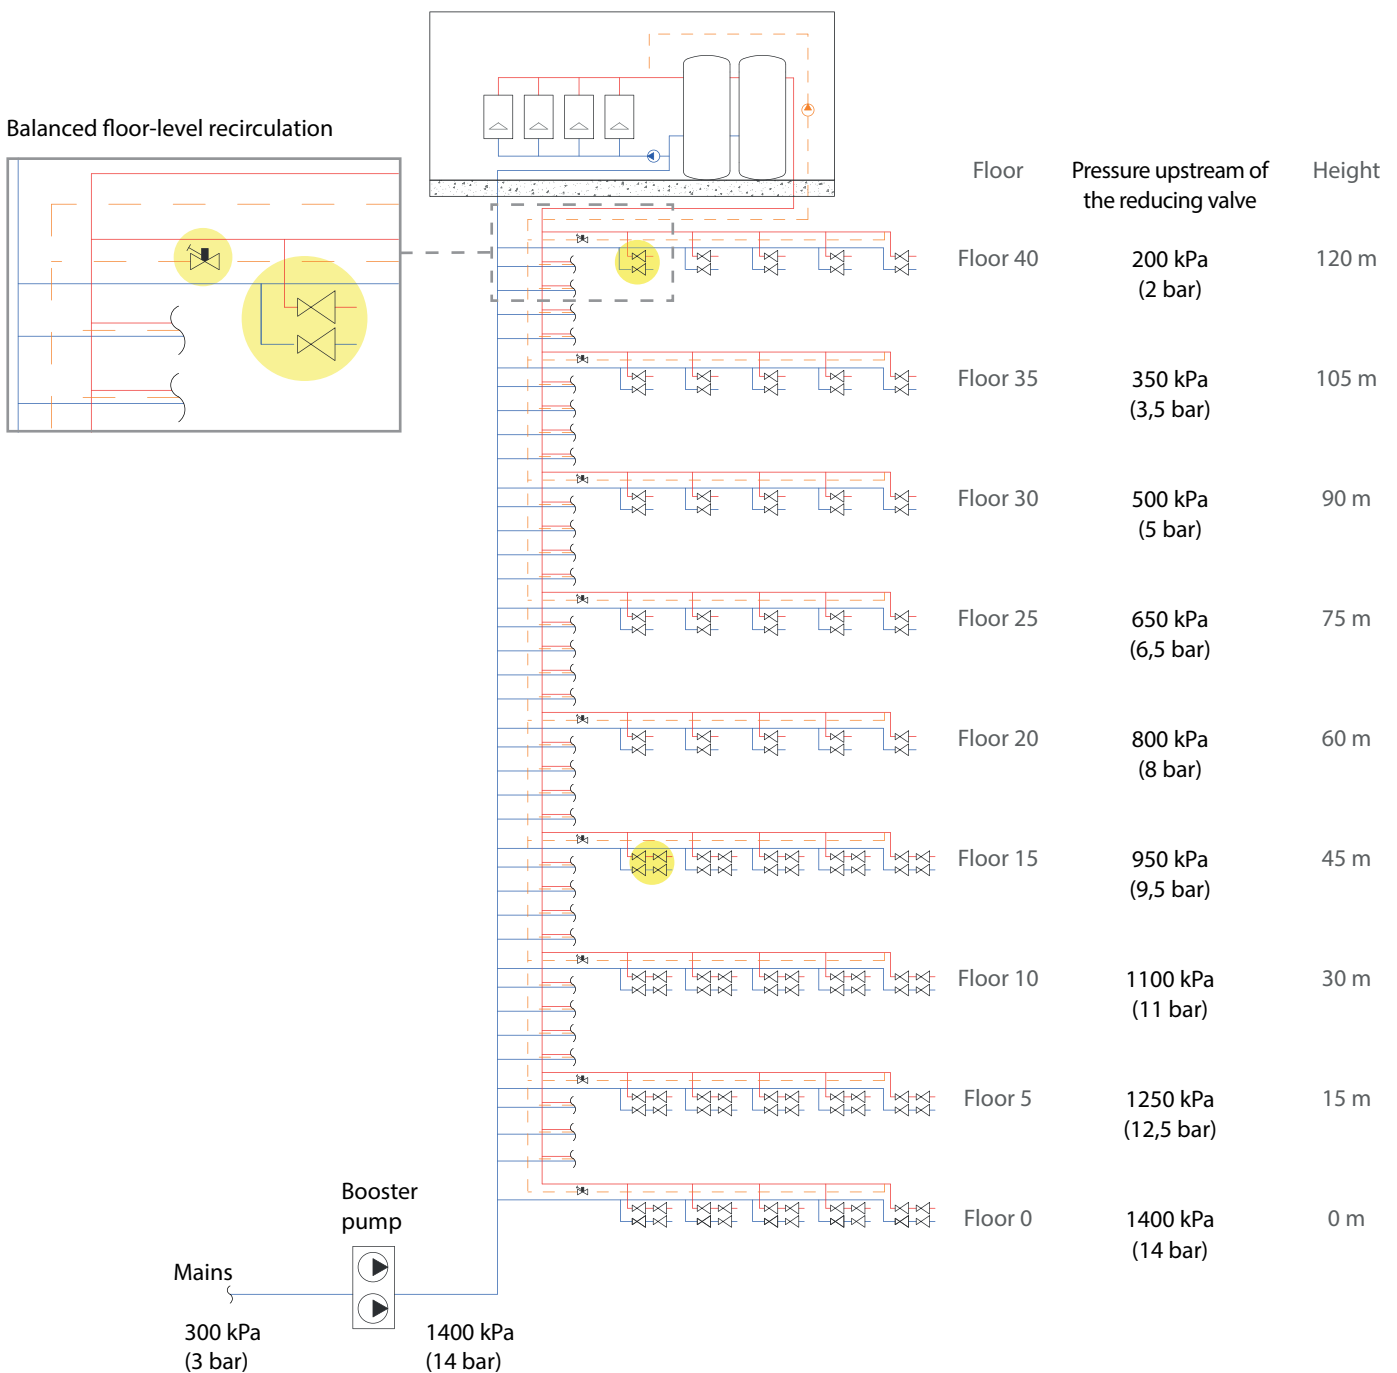


DIAGRAM 9	40-FLOOR BUILDING WITH CISTERNS AT ATMOSPHERIC PRESSURE
SYSTEM FEATURES	<ul style="list-style-type: none"> <li>• Intermediate plant floor and on the roof;</li> <li>• Cisterns at atmospheric pressure with reserve function;</li> <li>• Pressure pump for the top floors;</li> <li>• Transfer pump to fill the cisterns with water;</li> <li>• Independent DHW production for each unit.</li> </ul>
FOCUS ON REDUCING VALVES	<ul style="list-style-type: none"> <li>• Pressure reducing valves per floor branch.</li> </ul>
ADVANTAGES	<ul style="list-style-type: none"> <li>• Floor-level pressure control, inlet pressure reduced to 300 kPa (3 bar);</li> <li>• Gravity distribution ensures pressure stability;</li> <li>• Double stage not required as the reduction ratios are within the established limits;</li> <li>• Cistern with reserve function and transfer pump (no need for a high-performance pump).</li> </ul>
DISADVANTAGES	<ul style="list-style-type: none"> <li>• Very large setup and load, need for dedicated spaces (spaces unavailable for commercial use);</li> <li>• DHW production within each unit, more components and spaces used;</li> <li>• More devices to maintain and check, in technical cupboards.</li> </ul>

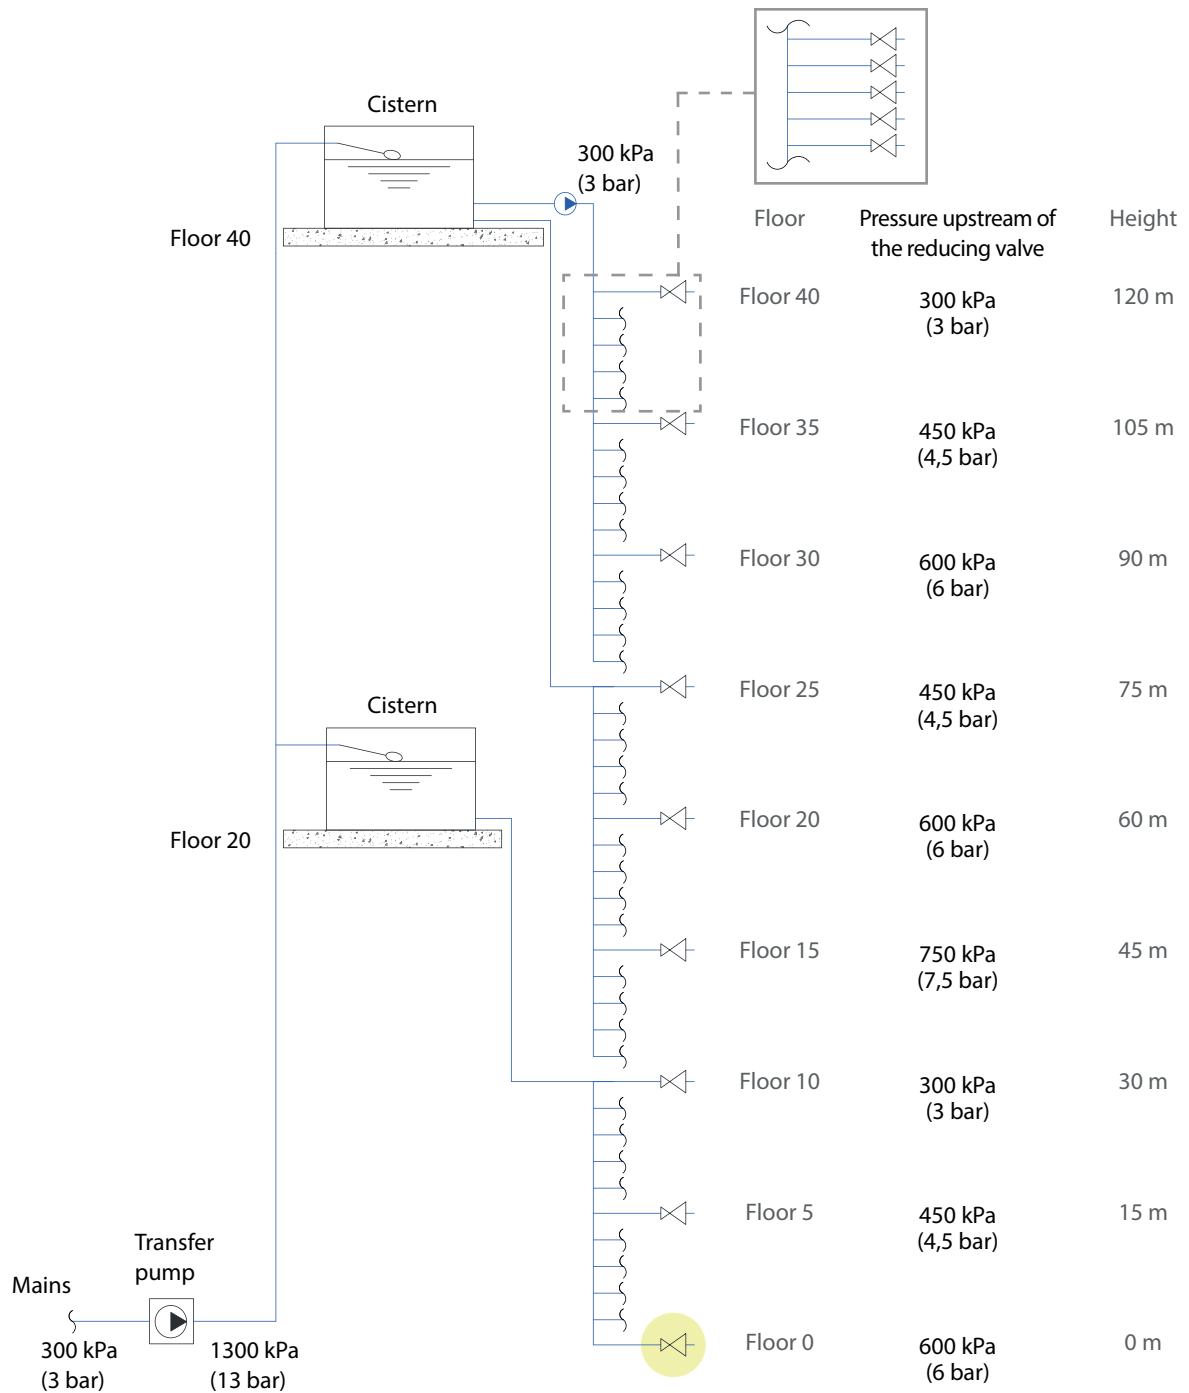


# INSTALLATION RECOMMENDATIONS

## General information


### Accessibility of the pressure reducing valve

To install a pressure reducing valve correctly, it is essential to choose a place that is easily accessible for maintenance and check operations, as well take system-level measures to facilitate such procedures. Moreover, it is not advisable to install these devices in places where cold, frost and weather could damage them.

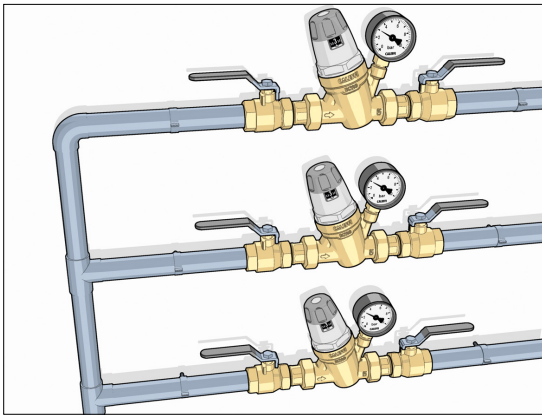

### Shut-off valves and pressure gauge

When installing pressure reducing valves, it is important to add shut-off valves to facilitate maintenance and a pressure gauge to check the pressure downstream from the device. Some models of reducing valves have a pressure gauge connection, while others have pressure gauges fitted as standard.

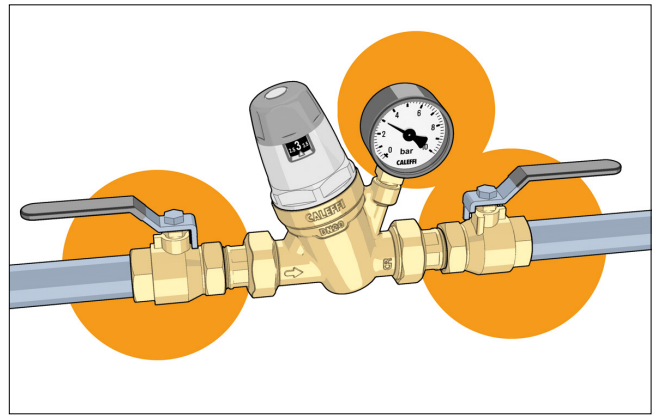


### Setting the pressure reducing valve

The pressure reducing valve is set after closing the downstream draw-off points. The pressure must always be checked with the pressure gauge to verify the setting.

The pressure reducing valve can be:


#### Adjustable

This must be set after it has been installed in the system. Turn the spring locking nut with a spanner or screwdriver; turning it clockwise increases the setting, or counter-clockwise decreases it.

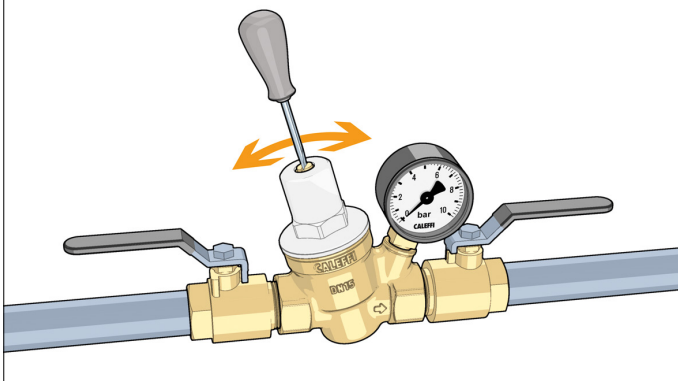


#### Presettable

This can be preset with a knob that has an indicator to show the setting. To increase the setting, just turn the knob clockwise. After installation, the system pressure will automatically adjust itself to the set value.

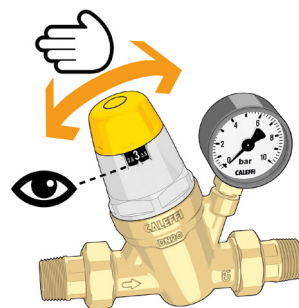

### Position of the pressure reducing valve


The pressure reducing valve may be installed with either vertical or horizontal pipes. However, to avoid dirt build-up problems and consequent obturator malfunction, it must not be upside down.

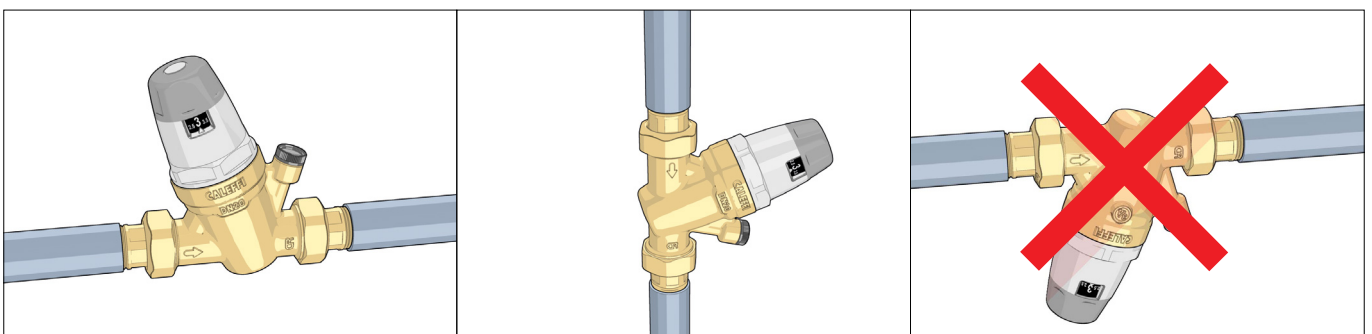


## Installation in presence of a recirculation circuit

In medium-large systems that require a hot water recirculation circuit, the pressure reducing valve locations must be carefully assessed. The pressure reducing valves must not be installed on sections of the circuit where hot water recirculates. The operating mechanism of the pressure reducing valve prevents it from being installed in this way because, when all the taps are closed, the downstream pressure is equal to the hydrostatic pressure at the installation point, so the obturator moves to the closed position, thus stopping the recirculation. The pressure reducing valves must therefore be installed outside the recirculation circuit.

**INCORRECT INSTALLATION**

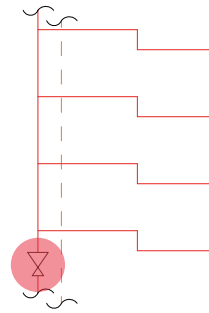


**CORRECT INSTALLATION**

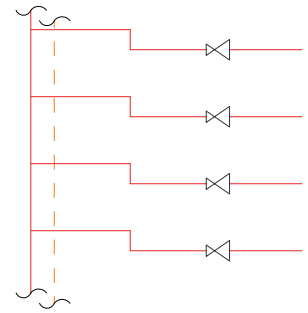


### Floor-level recirculation with pressure reducing valves in series

When recirculation is closed at the floor level, a typical error is to insert the first stage pressure reducing valve at the start of the distribution line. The pressure reducing valve on the hot water line is in the recirculation circuit and cannot operate. For this reason, the first and second stage pressure reducing valves must be inserted outside the recirculation circuit, at the inlets to the individual units.

**INCORRECT INSTALLATION**

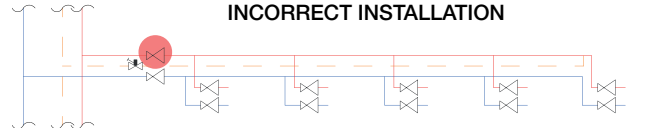


**CORRECT INSTALLATION**

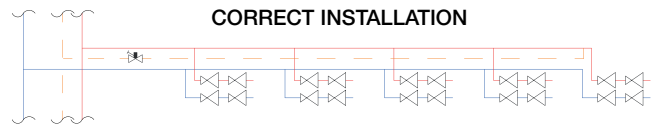

### Installation with heat exchanger and recirculation circuit


A system solution that allows the use of pressure reducing valves even when there is a recirculation circuit consists of installing a plate heat exchanger. The secondary recirculation system is kept at temperature by a heat exchanger with hot water from the generator/storage circulating in its primary. Once the water in the primary circuit has passed through the heat exchanger, it then returns to the central heating system to be heated. This system solution consists of a main high-pressure recirculation circuit and a secondary low-pressure recirculation circuit.

The secondary circuit is controlled by a pressure reducing station, which can consist of several pressure reducing valves in a by-pass or series configuration. The secondary circuit has a dedicated pump, an expansion vessel and all the safety and protection devices.

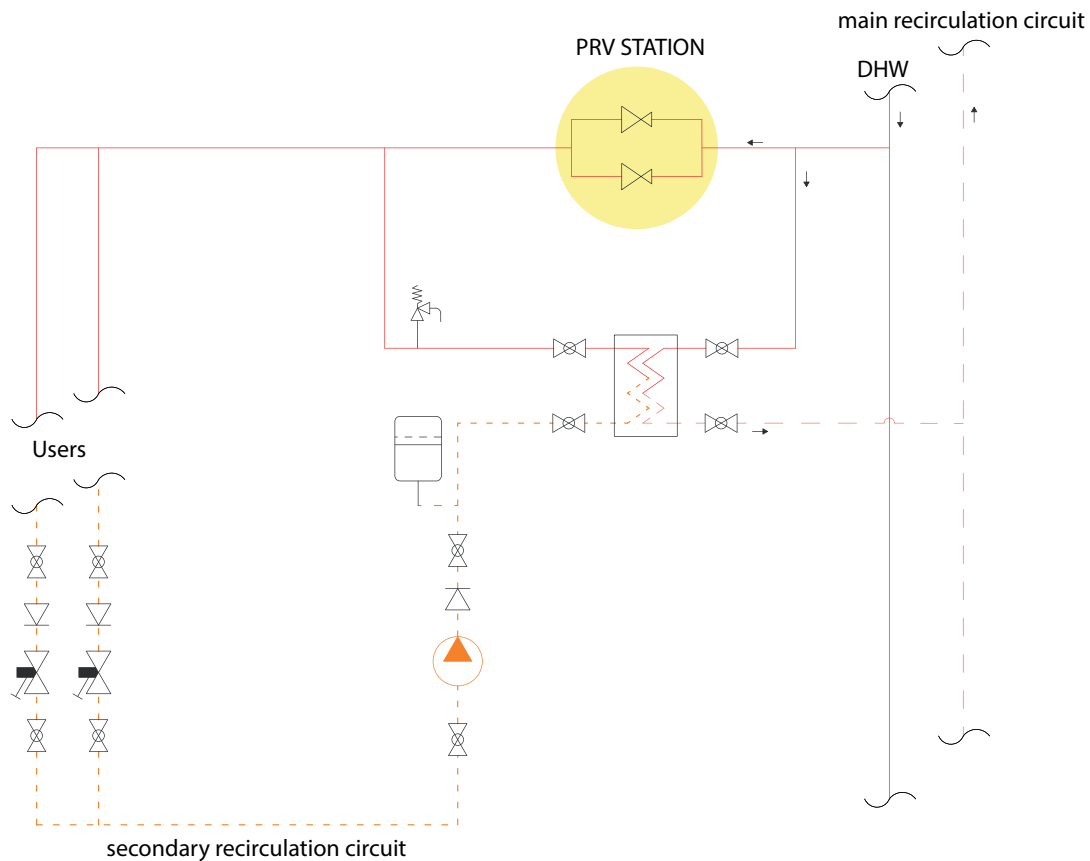

This solution provides hot water at the correct pressure on the secondary circuit, without having to install a pressure reducing valve for each user outside the recirculation circuit. The pressure is controlled by means of the pressure reducing valves at the inlet to the secondary circuit (PRV station), so that there is no need to keep the entire distribution network at high pressures up to the users. This is a useful solution for high buildings where there is a considerable hydrostatic pressure. The PRV station controls pressure during all flow or no flow condition.

BUILDING WITH INTERMEDIATE HEAT EXCHANGER FOR THE RECIRCULATION CIRCUIT	
<b>SYSTEM FEATURES</b>	<ul style="list-style-type: none"> <li>• Intermediate plant floor and on the roof;</li> <li>• Cascaded DHW generators at a pressure of about 200 kPa (2 bar);</li> <li>• Intermediate heat exchanger for recirculation at the lower floors.</li> </ul>
<b>FOCUS ON REDUCING VALVES</b>	<ul style="list-style-type: none"> <li>• Pressure reducing valve per single unit;</li> <li>• Pressure reducing valve on the main riser.</li> </ul>
<b>ADVANTAGES</b>	<ul style="list-style-type: none"> <li>• Local pressure control;</li> <li>• Pressure reducing valve on the main riser as a first reduction stage for the lower floors;</li> <li>• Fewer pressure reducing valves installed because there is no need to install pressure reducing valves in series at the inlet of each unit.</li> </ul>
<b>DISADVANTAGES</b>	<ul style="list-style-type: none"> <li>• Intermediate plant room for the heat exchanger and related distribution and safety components;</li> <li>• Need for dedicated spaces (spaces unavailable for commercial use).</li> </ul>

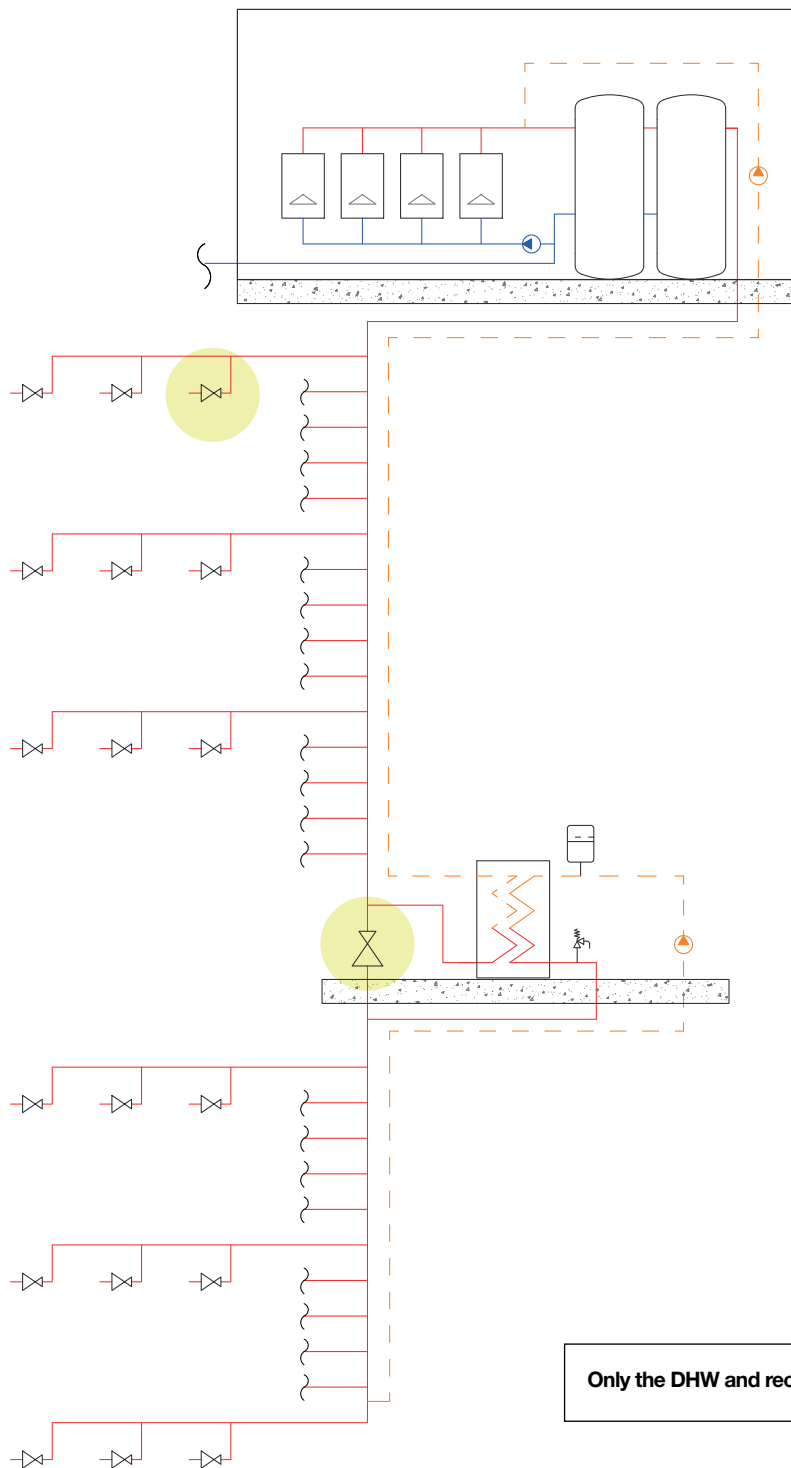

Only the DHW and recirculation is shown for simplicity

# MAINTENANCE

## General rules

The pressure reducing valves must be checked and serviced in accordance with the applicable national standards and following the manufacturer's instructions.

### Inspection frequency

The technical standards prescribe system-level measures to be considered during design in order to facilitate access to the appliances and maintenance operations thereon.


Information is provided on inspection and maintenance frequencies for the various components in potable water systems. Maintenance and inspection operations must be carried out at least once a year for pressure reducing valves.

Each Country and building location may have different requirements for frequencies of inspection and maintenance methods.

### Maintenance operations

The following steps are necessary for the cleaning, inspection and replacement of the entire cartridge:


1. Shut off the pressure reducing valve and remove the cartridge;
2. Clean the strainer and check the condition of the cartridge;
3. Reassemble everything and put it back into operation.

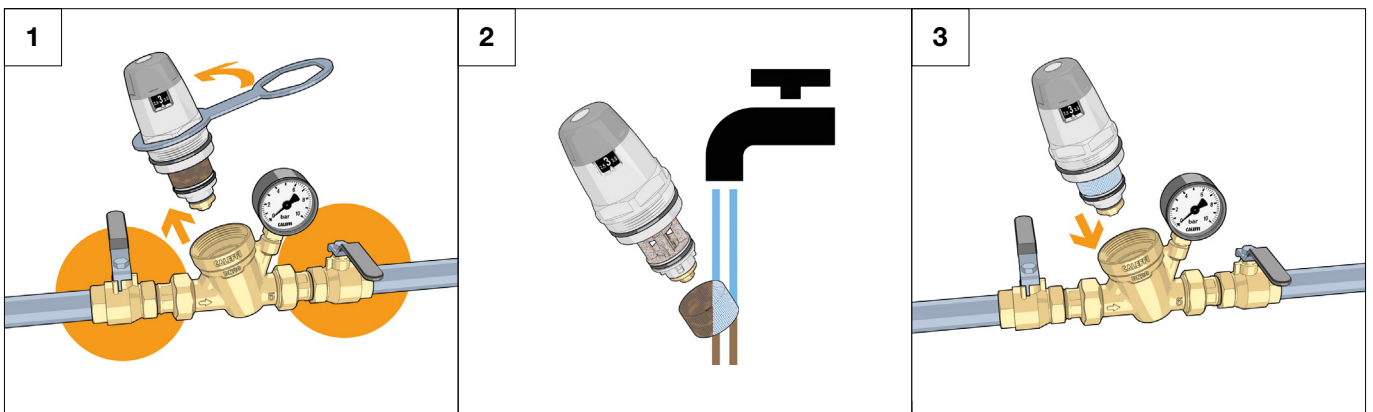

## Cartridges and strainers


### Conventional cartridge

The internal cartridge in pressure reducing valves can be removed for regular cleaning and maintenance. When removing the cartridge, be careful of the individual parts that are pulled out.

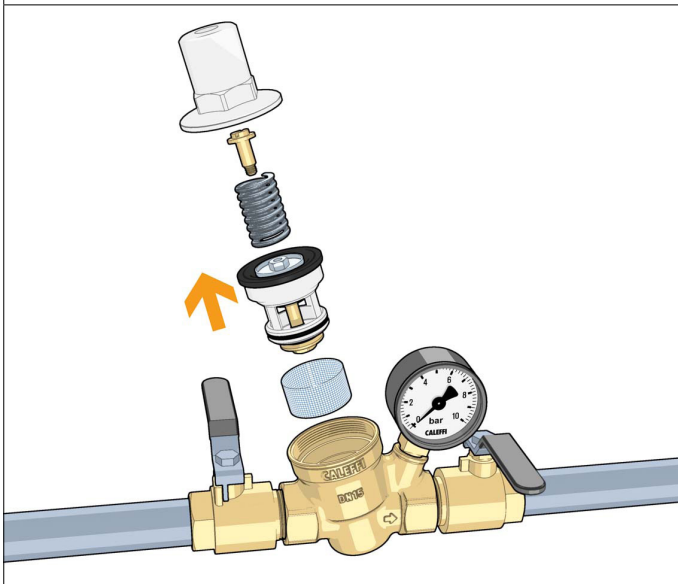


### Self-contained cartridge


The cartridge containing the diaphragm, strainer, seat, obturator and compensation piston is a pre-assembled self-contained unit with a cover, and can be removed to facilitate inspection and maintenance operations.

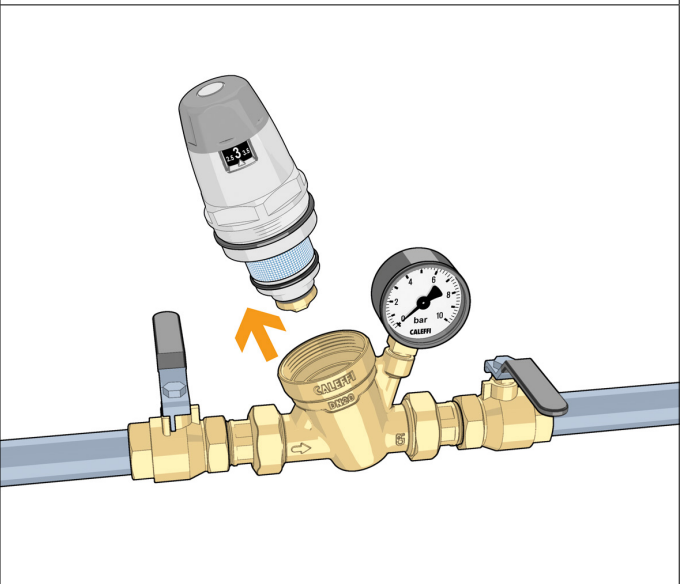

A strainer must always be installed to protect the pressure reducing valve. There are several configurations:

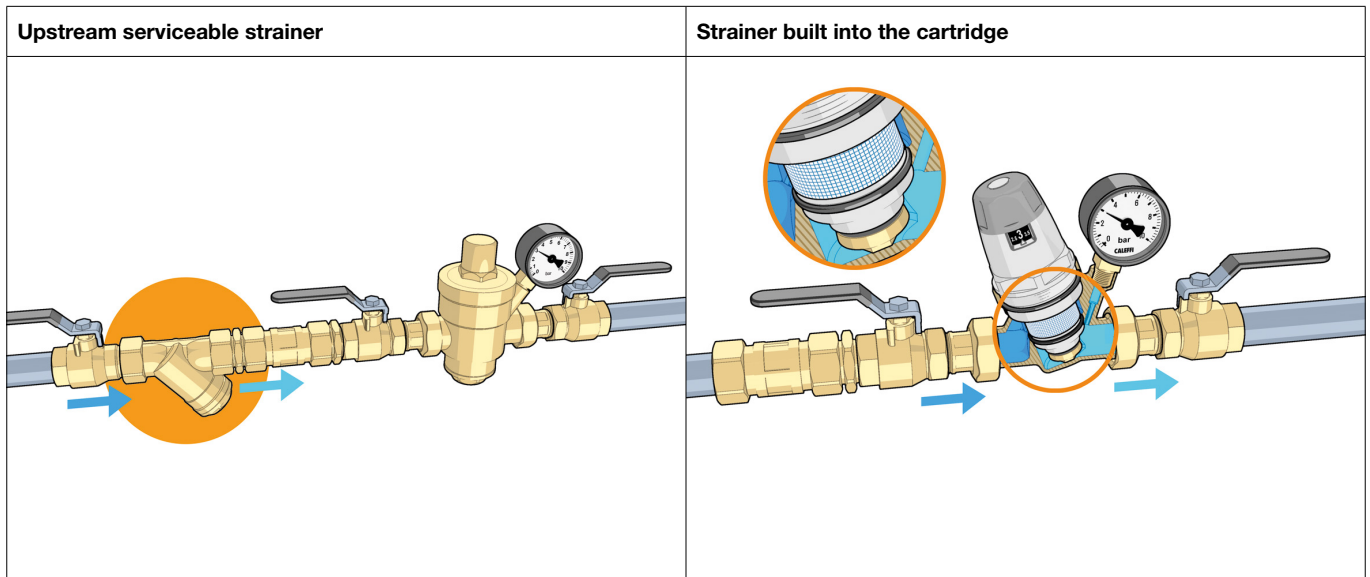

In systems with a high impurity content, it is advisable to install a serviceable strainer upstream of the pressure reducing valve, even if it already has a built-in strainer, in order to perform double filtration.

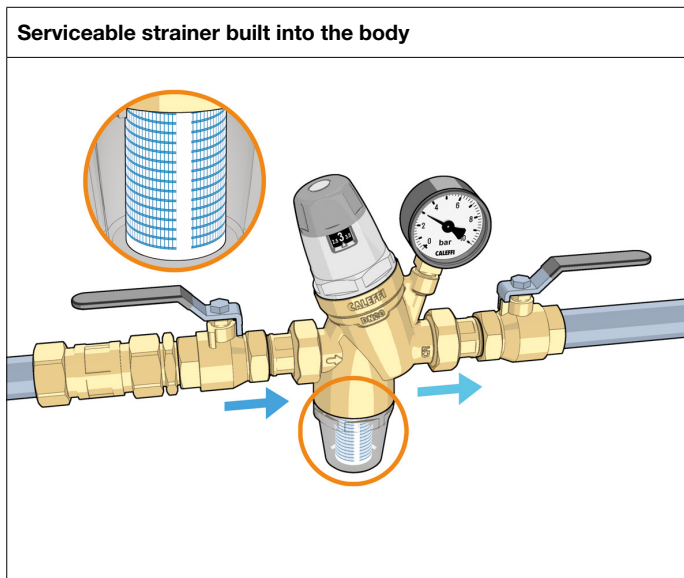


Some pressure reducing valve models are fitted with a high-capacity serviceable strainer, located in a special transparent container. In this way, the pressure reducing valve is a single compact component with protection against impurities that could compromise its operation.

The strainers must undergo periodic maintenance, be installed in a serviceable location and allow quick access for cleaning and replacement.

# PRESSURE CONTROL AND COMBINATION WITH OTHER COMPONENTS

Compact kits have been developed to control the pressure at the inlets of individual units, hotel rooms or hospital rooms. They combine different functions, reduce space and facilitate component installation and maintenance.

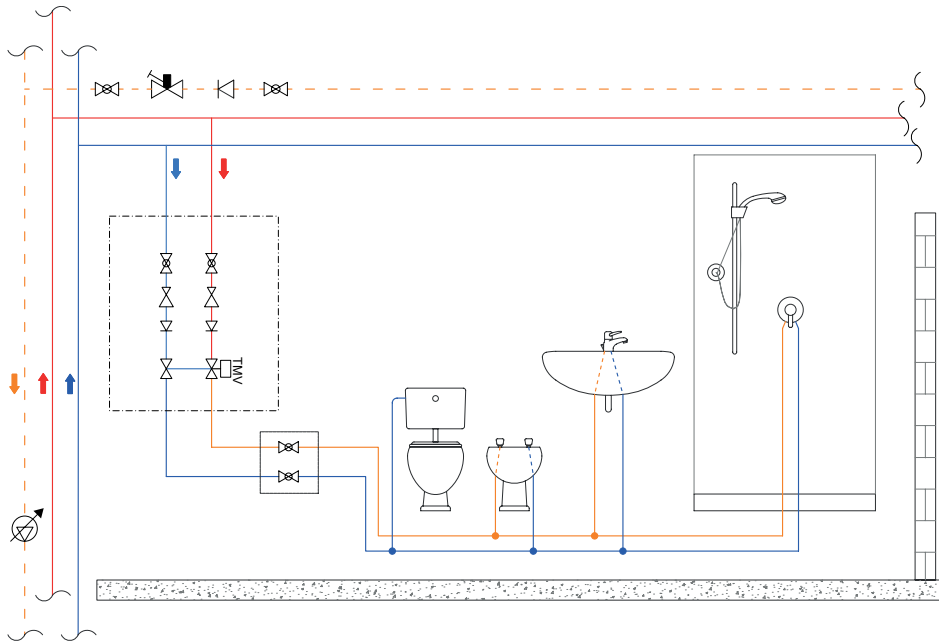


## Combined group for pressure control in domestic water systems

The combined group for pressure control in domestic water systems combines three different devices in a single housing:

1. Ball shut-off valve;
2. Pressure reducing valve with strainer;
3. EA anti-pollution check valve.

Installed on the hot or cold water distribution pipes in domestic water systems, it reduces the pressure of the water coming from the mains, prevents water backflow into the mains and allows user circuits to be shut off during testing and maintenance operations.

The check valve in the combined group serves as water protection and is required in some Countries or location (refer to the national regulations on anti-pollution devices).

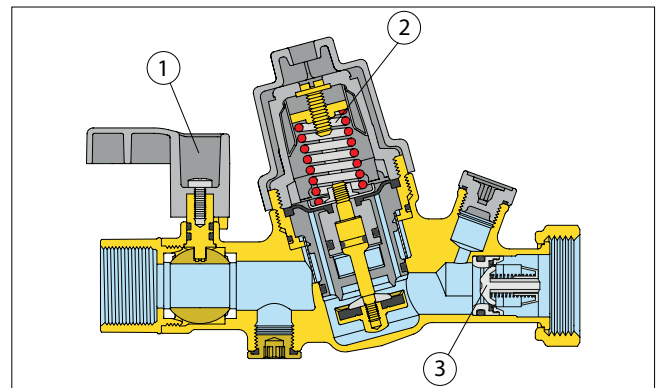


## Removable self-contained cartridge

The pressure reducing valve cartridge is a pre-assembled self-contained unit with a cover. It is easy to remove, simplifying inspection and maintenance procedures. The internal strainer is part of the cartridge and cannot be removed.


## Compact design and versatility

The assembly is designed to be compact, in order to make hydraulic installation easier where space is limited. As it consists of a single body, it limits the number of connections and installation time required.

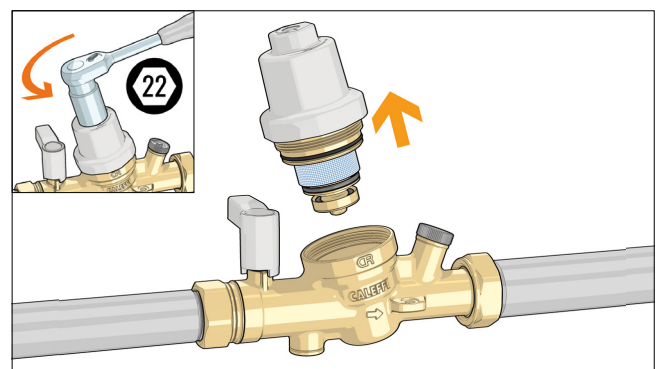


## Pressure test ports

The group has an upstream pressure test port which can be used for pressure control at the inlet. It is also fitted with a downstream pressure test port for installation of a pressure gauge or inspection of the check valve.

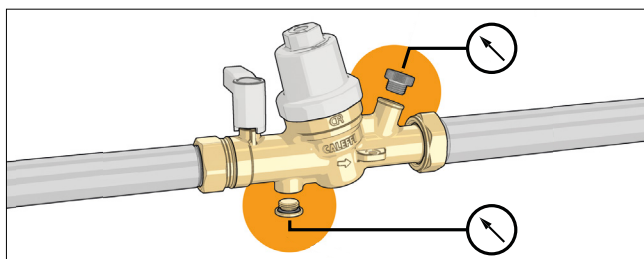

## Component connection


The group is constructed to make installing a water meter and other downstream equipment easier.

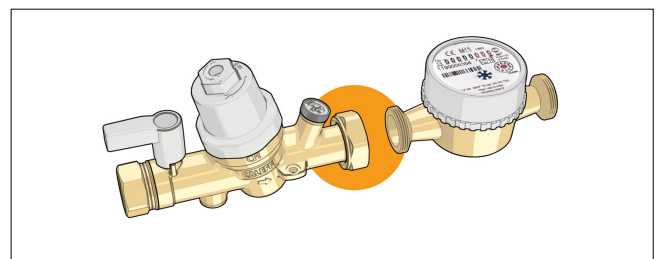




### Insulation

The combined group can be provided with insulation dimensioned to limit heat loss, especially when used on the domestic hot water line. The unit allows insulation to be applied without having to remove the lever. It is also designed for installation of a pressure gauge in the dedicated housing. The cartridge can be taken out without the need to remove the insulation.

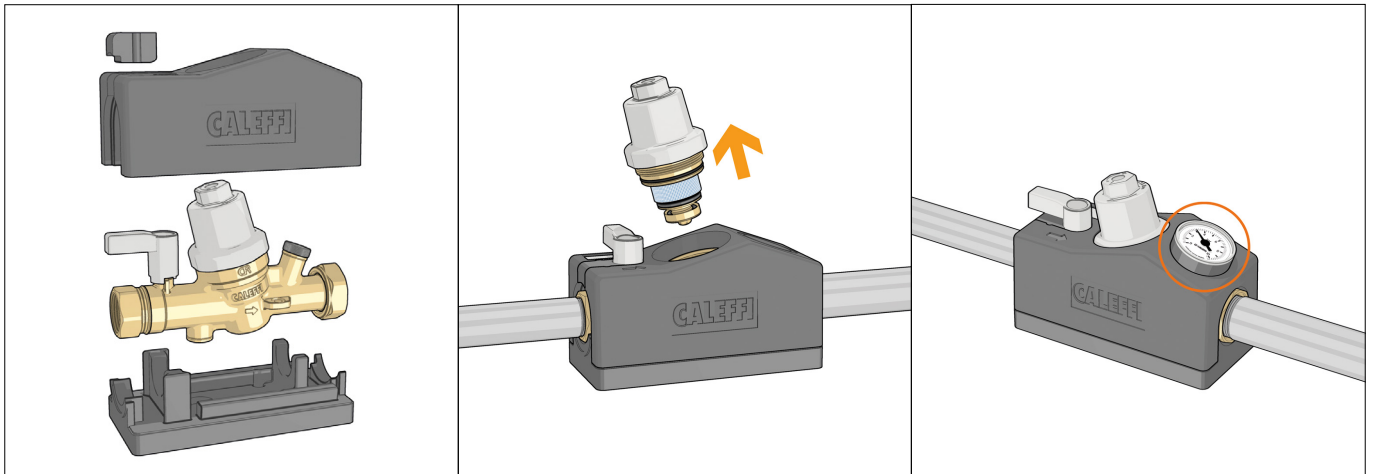


### Combined group for pressure and temperature control in domestic water systems

The combined group for pressure control can be coupled with a thermostatic mixing valve using the appropriate connection tee. To ensure full pressure and temperature control at the inlet to a property unit, hotel room or hospital room, two combined pressure control groups can be installed followed by a thermostatic mixing valve. Its compact size and ease of installation make it the ideal solution for all applications that require local temperature and pressure control. It offers the great benefit of being easily installed and maintained, and is suitable for a range of installation types.

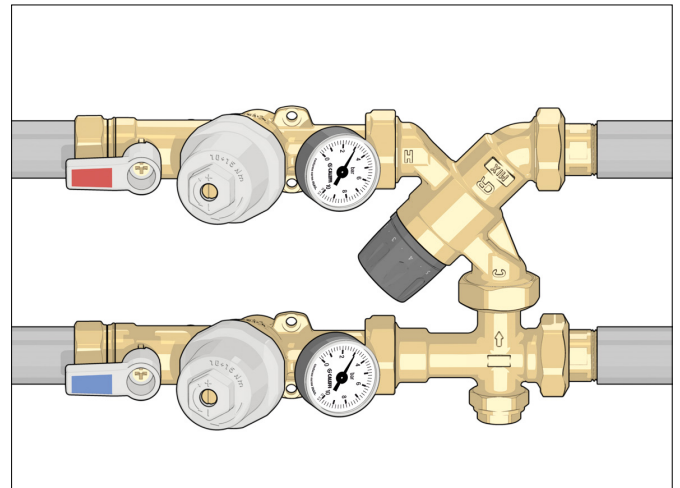

### Installation in individual bathrooms and floor-level recirculation

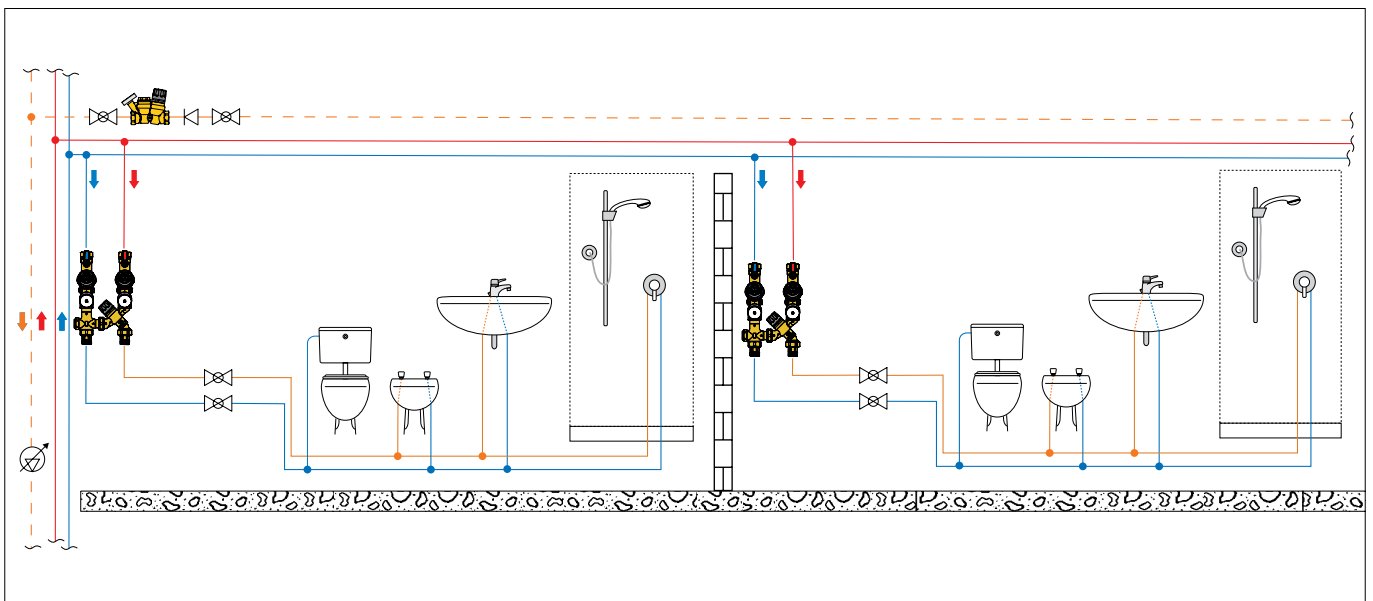

# TROUBLESHOOTING

Some typical malfunctions may occur in a system equipped with pressure reducing valves. Certain types of fault are often attributed to pressure reducing valves, but are actually due to a lack of certain system-level measures. This can compromise normal pressure reducing valve operation, or even damage it irreversibly, causing further problems to the whole system.

## Pressure rise downstream of the reducing valve

Overheating of the water downstream from the pressure reducing valve causes a pressure increase. There is no pressure relief because the reducing valve is correctly closed.

This condition can be recognised when the downstream pressure exceeds the setting pressure. Sometimes the values reached may be higher than the upstream pressure.

The solution consists of installing an expansion vessel (between the pressure reducing valve and the storage) or another device, such as an expansion valve, to absorb the increase in downstream pressure. Without this system-level measure, the pressure reducing valve could be damaged if the pressures reach high values, compromising the diaphragm and therefore device operation.



To limit the pressure increase due to thermal expansion in particularly large systems, it is advisable to limit the length of the pipes downstream of the pressure reducing valves.

For series pressure reducing valves, the length of the pipes between the first and second stages must also be limited in order to reduce the expansion.

Thermal expansion and overpressure can be amplified if the pipes are close to heat sources (nearby hot pipes, hot environments, heat from direct sunlight).

The expansion vessel helps control the system pressure, but is not a safety device.

It is therefore necessary to install safety devices as required in the Country of installation, which intervene if the vessel is damaged.

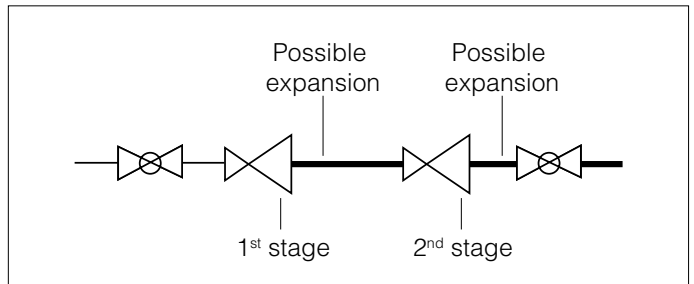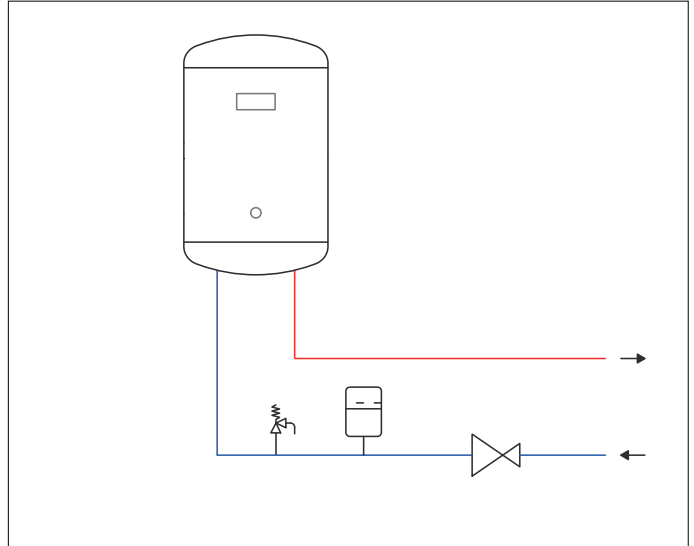


### Built-in expansion by-pass device

Some manufacturers have developed solutions with an expansion by-pass device built into the pressure reducing valve. This built-in by-pass allows the water to expand from downstream to the upstream main network through an internal device. However, when choosing these components, attention must be paid to the pressure limits imposed by the device manufacturers.

If the by-pass device becomes dirty, the pressure reducing valve can no longer regulate the pressure correctly.

It is not the task of the pressure reducing valve to control/absorb the water expansion in a system. It is advisable to provide devices such as expansion vessels and safety valves to prevent damage to the pressure reducing valve and other system components.

Moreover, in some systems the regulations do not allow the expansion and consequent backflow of water from downstream to upstream. For this reason, the use of these types of products must be assessed carefully.

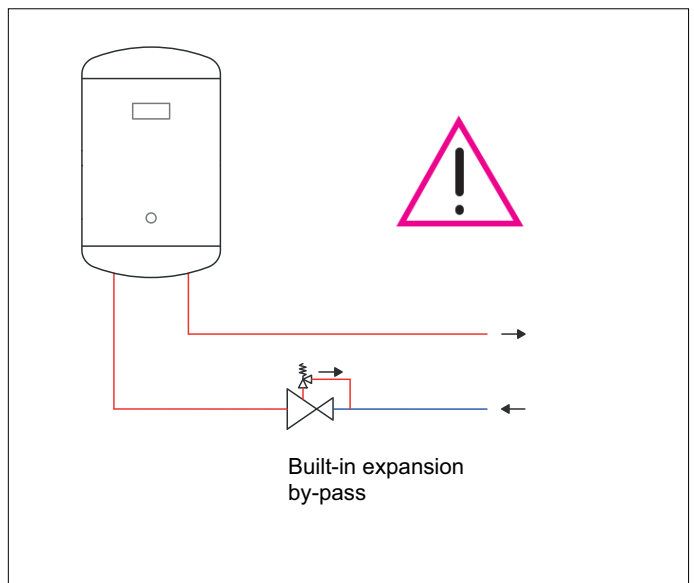


## Water hammer

Water hammer is caused by valves opening or closing quickly. It can cause dangerous pressure increases in the system, well above the allowable working pressure, and is one of the main causes of failure in components and pressure reducing valves.

It is best to fit special devices to absorb water hammer when installing pressure reducers in at-risk systems.

It is recommended to install a check valve, when required by system lay-out.

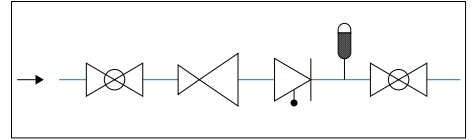


## Presence of impurities

Impurities that settle on the seal seat often cause issues in pressure reducing valves related to stabilisation at the setting value due to leakage. This results in the pressure being regulated incorrectly.

The preventive solution is to install a strainer upstream of the reducing valve and then to ensure that the removable cartridge is properly cleaned and maintained.

An upstream strainer can therefore prevent malfunctions that are often wrongly attributed to the pressure reducing valve.



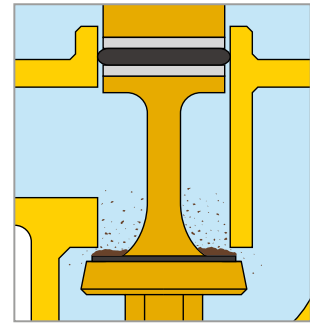


This condition results in the downstream pressure being equal to the upstream pressure since the two zones are connected via the imperfect seal.











## Troubleshooting typical problems on pressure reducing valves






PROBLEM	CAUSE	ACTION TO BE TAKEN
The downstream pressure does not remain stable at the setting and tends towards the upstream pressure (creeping)	Impurities on the seal seat leading to leakage.	Install a strainer upstream of the pressure reducing valve. Carry out maintenance on the cartridge and clean it.
The downstream pressure increases above the setting	Water overheating inside the pipes due to hot water storage, especially when not in use for long periods.	Install an expansion vessel between the pressure reducing valve and the hot water storage.
Recirculation circuit malfunction	Pressure reducing valve installed incorrectly.	Move the pressure reducing valve out of the recirculation circuit.
Water leakage from the cover	Broken diaphragm.	System-level measures to manage possible water hammer and sudden pressure increases. If necessary, use a piston pressure reducing valve, which is more robust than the diaphragm type.
Noise and vibration	Incorrect sizing or cavitation.	Replace the pressure reducing valve with one of a different size. Install pressure reducing valves in series or in parallel.
Pressure between cold and hot domestic water differs too much at the draw-off point and the mixed water temperature is unstable.	Pressure between cold and hot water is unbalanced.	Check the location, setting and installation of the pressure reducing valves. Adjust the system accordingly. Install thermostatic mixing valves.






## CALEFFI PRODUCTS







Type	INCLINED BODY				MICRO PRESSURE REDUCING VALVE
Series	5330	5332	5331	5334	533..H
					
<b>Body</b>	Brass EN 12165 CW617N, chrome plated				Dezincification resistant alloy <b>CR</b> EN 12165 CW724R <b>LOW LEAD</b>
<b>Cartridge and strainer</b>	Removable				
<b>Upstream Pmax</b>	1600 kPa (16 bar)				
<b>Setting range</b>	100–600 kPa (1–6 bar)				80–400 kPa (0,8–4 bar)
<b>Working Tmax</b>	40 °C				80 °C
<b>Sizes and maximum recommended flow rates</b>	DN 15 (1/2") 0,3 l/s DN 20 (3/4") 0,36 l/s	DN 15 (3/4" M x 3/4" nut) 0,3 l/s	DN 15 (1/2") 0,3 l/s DN 20 (3/4") 0,36 l/s DN 20 (1") 0,36 l/s	DN 8 (3/8") 0,1 l/s	
<b>Certification</b>	ACS				ACS, SVGW, DVGW, WRAS, KIWA, KIWA REG4
<b>Typical users</b>	Small user circuit Hotel room Small property unit				Coffee machines, water and beverage dispensers

Type	INCLINED BODY			
Series	5336	5337	5338	5335 AUS
				
<b>Body</b>	Dezincification resistant alloy <b>CR</b> EN 12165 CW602N, chrome plated			Dezincification resistant alloy <b>CR</b> EN 12165 CW602N
<b>Cartridge and strainer</b>	Removable			
<b>Upstream Pmax</b>	1600 kPa (16 bar)			
<b>Setting range</b>	100–600 kPa (1–6 bar)			
<b>Working Tmax</b>	40 °C			
<b>Sizes and maximum recommended flow rates</b>	DN 15 (Ø 15) 0,3 l/s DN 20 (Ø 22) 0,36 l/s			DN 15 (1/2") 0,3 l/s DN 20 (3/4") 0,36 l/s
<b>Certification</b>	WRAS, KIWA REG4			WATERMARK
<b>Typical users</b>	Small user circuit Hotel room Small property unit			

Type	INCLINED BODY for high temperatures			
Series	5330 H	5332 H	5334 H	5331 H
				
Body	Brass EN 12165 CW617N, chrome plated	Brass EN 12165 CW617N, chrome plated		Dezincification resistant alloy <b>CR</b> EN 12165 CW602N
		LTC Version Dezincification resistant alloy <b>CR</b> EN 12165 CW602N, chrome plated		
Cartridge and strainer	Removable			
Upstream Pmax	1600 kPa (16 bar)			
Setting range	100–550 kPa (1–5,5 bar)			
Working Tmax	80 °C			
Sizes and maximum recommended flow rates	DN 15 (1/2") 0,36 l/s DN 20 (3/4") 0,5 l/s	DN 15 (1/2") 0,36 l/s DN 20 (3/4") 0,5 l/s DN 20 (1") 0,58 l/s		DN 20 (Ø 22 x 3/4" nut) 0,5 l/s
Certification	ACS, DVGW, SVGW, KIWA	ACS, DVGW, SVGW, KIWA (LTC version) WRAS, KIWA REG4		WRAS, KIWA REG4
Typical users	Small user circuit Hotel room Small property unit			



Type	INCLINED BODY for high temperatures				
Series	5336 H	5337 H	5338 H	5335 H AUS	5335 HS AUS
					
Body	Dezincification resistant alloy <b>CR</b> EN 12165 CW602N, chrome plated			Dezincification resistant alloy <b>CR</b> EN 12165 CW602N	
Cartridge and strainer	Removable				Piston type, removable
Upstream Pmax	1600 kPa (16 bar)			2000 kPa (20 bar)	
Setting range	100–550 kPa (1–5,5 bar)			100–600 kPa (1–6 bar)	
Working Tmax	80 °C				
Sizes and maximum recommended flow rates	DN 15 (Ø 15) 0,36 l/s DN 20 (Ø 22) 0,5 l/s	DN 15 (Ø 15) 0,36 l/s DN 20 (Ø 22) 0,5 l/s DN 20 (Ø 28) 0,58 l/s		DN 15 (1/2") 0,36 l/s DN 20 (3/4") 0,5 l/s DN 25 (1") 0,58 l/s	DN 15 (1/2") 0,36 l/s DN 20 (3/4") 0,5 l/s
Certification	WRAS, KIWA REG4			WATERMARK	
Typical users	Small user circuit Hotel room Small property unit				High-rise buildings

Type	WITH DIAL UP			WITH DIAL UP for high temperatures	
Series	5350	5350	5351	5350..H	5350..H AUS
					
Body	Dezincification resistant alloy <b>CR</b> EN 1982 CC770S	Dezincification resistant alloy <b>CR</b> EN 12165 CW602N	Brass EN 12165 CW617N	Dezincification resistant alloy <b>CR</b> EN 1982 CC768S <b>LOW LEAD</b>	
Cartridge and strainer	Removable self-contained		Removable self-contained, strainer in transparent container	Removable self-contained	
Upstream Pmax	2500 kPa (25 bar)			2500 kPa (static) (25 bar) 1600 kPa (working) (16 bar)	2000 kPa (20 bar)
Setting range	100–600 kPa (1–6 bar)				
Working Tmax	40 °C			80 °C	
Sizes and maximum recommended flow rates	DN 15 (1/2") 0,5 l/s DN 20 (3/4") 0,66 l/s DN 25 (1") 0,83 l/s DN 32 (1 1/4") 2 l/s DN 40 (1 1/2") 2,66 l/s DN 50 (2") 2,83 l/s	DN 20 (Ø 22) 0,66 l/s	DN 15 (1/2") 0,41 l/s DN 20 (3/4") 0,58 l/s DN 25 (1") 0,83 l/s	DN 15 (1/2") - DN 15 (Ø 15) 0,5 l/s DN 20 (3/4") - DN 20 (Ø 22) 0,83 l/s DN 25 (1") - DN 25 (Ø 28) 1,16 l/s DN 32 (1 1/4") 2,16 l/s DN 40 (1 1/2") 3 l/s DN 50 (2") 3,83 l/s	DN 15 (1/2") 0,5 l/s DN 20 (3/4") 0,83 l/s DN 25 (1") 1,16 l/s DN 32 (1 1/4") 2,16 l/s DN 40 (1 1/2") 3 l/s DN 50 (2") 3,83 l/s
Certification	DVGW, ACS, SVGW, WRAS, KIWA REG4	WRAS, KIWA REG4	DVGW, ACS, SVGW,	WRAS, ACS, DVGW, SVGW, KIWA, SINTEF, KIWA REG4	WATERMARK
Typical users	Medium user circuits				

Type	STRAIGHT BODY for high temperatures					FIRST STAGE for high temperatures
Series	539	5360 (5360.1/0)	5362 (5362.1/0)	5365	5366	5360 AUS
						
Body	Dezincification resistant alloy <b>CR</b> EN 1982 CC770S			Bronze EN 1982 CB499K		Dezincification resistant alloy <b>CR</b> EN 1982 CC770S
Cartridge and strainer	Removable					Piston type, removable
Upstream Pmax	2500 kPa (25 bar)				1600 kPa (16 bar)	2500 kPa (25 bar)
Setting range	100–550 kPa (1–5,5 bar)	50–600 kPa (0,5–6 bar)				600–1000 kPa (6–10 bar)
Working Tmax	80 °C					
Sizes and maximum recommended flow rates	DN 20 (3/4") 0,83 l/s	DN 15 (1/2") 0,36 l/s DN 20 (3/4") 0,75 l/s DN 25 (1") 0,83 l/s DN 32 (1 1/4") 1,5 l/s DN 40 (1 1/2") 2,33 l/s	DN 15 (1/2") 0,36 l/s DN 20 (3/4") 0,75 l/s DN 25 (1") 0,83 l/s	DN 40 (1 1/2") 2,33 l/s DN 50 (2") 3,33 l/s	DN 65 4,41 l/s	DN 15 (1/2") 0,36 l/s DN 20 (3/4") 0,75 l/s DN 25 (1") 0,83 l/s DN 32 (1 1/4") 1,5 l/s DN 40 (1 1/2") 2,33 l/s
Certification	ACS, NF	WRAS, ACS, KIWA REG4				WATERMARK, WRAS, KIWA REG4
Typical users	Medium user circuits					First stage

Type	PRESSURE REDUCING AND STABILISING VALVES	
	DIRECT ACTING	WITH PILOT CIRCUIT
Series	576	578
	A blue, vertical, direct-acting pressure-reducing valve with a single inlet and outlet, and a pressure gauge on the side.	A blue, horizontal, pressure-reducing valve with a pilot circuit, featuring multiple ports, a pressure gauge, and a Y-strainer.
Body	Cast iron	
Cartridge	Piston	Diaphragm
Strainer	Not present	Y strainer on pilot circuit
Upstream Pmax	1600 kPa (16 bar) 2500 kPa (25 bar) on request 4000 kPa (40 bar) on request	1600 kPa (16 bar) (DN 65 – DN 150, PN16) (DN 200 – DN 300, PN 10)
Setting range	200–1400 kPa (2–14 bar)	200–1400 kPa (2–14 bar)
Working Tmax	60 °C	65 °C
Sizes and maximum recommended flow rates	DN 65 5,8 l/s DN 80 9,2 l/s DN 100 14,2 l/s DN 125 21,7 l/s DN 150 31,8 l/s	DN 65 10 l/s DN 80 15 l/s DN 100 28 l/s DN 125 38 l/s DN 150 50 l/s DN 200 110 l/s DN 250 190 l/s DN 300 300 l/s
Certification	ACS	ACS, WRAS
Typical users	Large user circuits, water distribution networks	

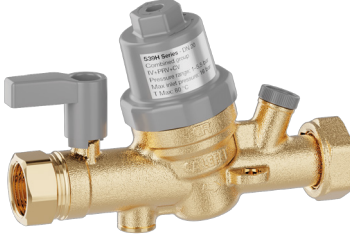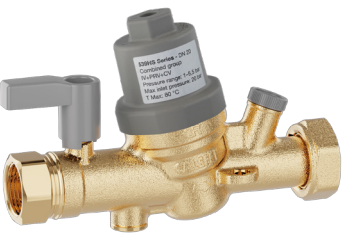

Type	COMBINED UNIT FOR PRESSURE CONTROL	
Series	539 H	539 HS
		
Body	Dezincification resistant alloy <b>CR</b> EN 12165 CW724R <b>LOW LEAD</b>	
Cartridge and strainer	Removable self-contained	Self-contained piston type, removable
Upstream Pmax	1600 kPa (16 bar)	2000 kPa (20 bar)
Setting range	100–550 kPa (1–5,5 bar)	
Working Tmax	80 °C	
Sizes and maximum recommended flow rates	DN 20 (Rp 3/4" x 1" nut) 0,41 l/s	
Certification	KIWA REG4, WRAS, ACS	
Typical users	Small user circuit Hotel room Small property unit	





*We reserve the right to make changes and improvements to our products and the related technical data in this publication, at any time and without prior notice. The website [www.caleffi.com](http://www.caleffi.com) always has the most up-to-date version of the document, which should be used for technical verifications.*



CALEFFI S.p.A. · S.R.229, N.25 · 28010 Fontaneto d'Agogna (NO) · Italia  
Tel. +39 0322 8491 · info@caleffi.com www.caleffi.com

© 2022 Copyright Caleffi

